




Station :

Commune :

Localisation :

Objectif de qualité : 1B

Catégorie piscicole : 2



X (m)	Y (m)
-------	-------

Lambert II : 445 790 2 252 450

Lambert 93 :	495 755	6 687 215
---------------------	---------	-----------

Altitude (m) : 35



Date prél.	Heure	Débit m3/s	T°eau °C	pH	Cond.25° µS/cm	O2 dis. mg/l	Sat. O2 %	MES mg/l	DBO5 mg/l	DCO mg/l	COD mg/l	N Kj mg/l	NH4+ mg/l	NO2- mg/l	NO3- mg/l	PO4--- mg/l	P Total mg/l	Chloro. a µg/l	Phéopig. µg/l
28/11/2008	11:00		7.1	8.1	558	7.5	63	< 2	2.1		4.0	1	0.11	0.06	24	0.24	0.09		
01/10/2008	15:30		14.1	8.1	570	5.3	52	4	1.9		3.7	1.1	0.05	0.04	21	0.14	0.07		
28/08/2008	11:10		19.7	8.2	539	5.7	62	8	1.4		6.0	1.4	< .05	0.03	20	0.24	0.11		
15/07/2008	15:17		21.7	7.7	565	7.9	88	9	2.7		6.2	< 1	0.05	0.04	23	0.2	0.1		
04/06/2008	13:00		19.3	7.7	349	5.4	58	35	3.1		13.0	1.6	0.09	0.05	6	0.38	0.18		
26/03/2008	12:20		8.9	8.6	478	6.3	55	38	2.4		8.0	1.7	0.1	0.1	25	0.25	0.13		
11/12/2007	13:45		8.5	7.7	478	10.5	89	50	2.9		12.0	< 1	0.18	0.11	23	0.56	0.24	5	6.5
23/10/2007	12:40		10.5	8.0	559	7.6	69	4	1.3			2.2	0.05	0.03	18	0.24	< .15	< 1	1.9
25/09/2007	12:05		15.8	7.9	555	10.0	101	5	1.4	< 5		2.5	0.08	0.03	20	0.23	< .15	< 1	5.4
21/08/2007	12:05		18.3	7.8	524	9.2	98	7	< 1	12		< 1	0.1	0.05	17	0.23	< .15	2.7	3
24/07/2007	12:20		20.7	7.8	482	10.7	121	< 2	1.8	13		1.7	0.1	0.05	17	0.32	< .15	1.4	1.3
19/06/2007	12:30		20.3	7.8	481	9.8	110	16	1.6	10		1.4	0.11	0.08	18	0.37	< .15	< 1	5
22/05/2007	14:30		18.9	7.9	572	8.6	92	< 2	2	11		1.1	0.11	0.08	27	0.35	< .15	< 1	1.9
13/02/2007	12:25		9.0	7.9	419	10.7	93	106	2.9	31		2	0.12	0.17	19	0.83	0.27	3.5	12
12/12/2006	11:55		7.8	7.9		9.4	79	169	2.8	28		1.1	0.28	0.39	21	0.91	0.36	< 1	12
24/10/2006	12:10		15.0	8.1		11.4	114	7	1.3	< 20		1.7	0.14	0.1	24	0.22	< .15	< 1	2.1
19/09/2006	12:35		19.7	7.5		7.4	81	5	1	< 20		1.1	0.09	0.1	13	0.31	< .15	2.4	12
22/08/2006	12:22		20.6	7.6				15	1.2	< 20		< 1	0.12	0.05	11	0.24	< .15	4.7	5
18/07/2006	12:30		25.6	6.9				7	2.7	< 20		1.7	0.08	0.07	18	0.23	< .15	2.4	3.8
20/06/2006	12:10		23.2	7.5		8.6	101	5	1	< 20		1.7	0.08	0.12	21	0.35	< .15	< 1	3.2
30/05/2006	11:50		17.8	7.5		9.6	101	9	< 1	< 20		< 1	0.11	0.1	19	0.35	< .15	< 1	3
14/02/2006	12:25		5.4	7.7		12.8	101	7	2.3	< 20		< 1	< .05	0.1	28	0.16	< .15	12	6.4

Date prél.	Heure	Débit m3/s	T°eau °C	pH	Cond.25° µS/cm	O2 dis. mg/l	Sat. O2 %	MES mg/l	DBO5 mg/l	DCO mg/l	COD mg/l	N Kj mg/l	NH4+ mg/l	NO2- mg/l	NO3- mg/l	PO4--- mg/l	P Total mg/l	Chloro. a µg/l	Phéopig. µg/l
13/12/2005	11:40		5.5	7.8		12.1	95	7	3.2	< 20		< 1	< .05	0.08	22	0.19	< .15	2.3	3.6
25/10/2005	12:05		15.8	6.9		8.9	90	4	1.7	< 20		1.4	0.07	0.11	14	0.26	< .15	1.2	1.4
20/09/2005	12:00		16.8	7.5		9.1	94	10	1.9	< 20		< 1	0.07	0.1	14	0.23	< .15	1.6	2.7
23/08/2005	13:10		20.6	7.5		8.6	96	9	2.1	< 20		< 1	0.08	0.06	16	0.2	< .15	3.4	3.6
26/07/2005	12:05		22.4	7.5		7.5	87	11	2	< 20		< 1	0.07	0.06	13	0.33	< .15	1.3	3.2
21/06/2005	11:45		25.0	7.4		5.9	71	10	2.1	< 20		1.1	0.09	0.08	15	< .15	< .15	2.8	4.7
24/05/2005	13:45		18.4	7.7		12.0	127	13	4	< 20		< 1	< .05	0.1	18	0.16	< .15	20	13
15/02/2005	12:15		6.7	7.5		11.6	96	28	2.3	< 20		1.1	0.16	0.14	31	0.27	< .15	5.2	5.7
14/12/2004	13:45		4.6	7.7		12.2	94	4	2.5	< 20		1.1	0.09	0.11	24	0.27	< .15	9.9	7
19/10/2004	12:20		13.8	7.7		9.8	96	8	3	< 20		< 1	< .05	0.07	14	0.23	< .15	6.1	5
20/09/2004	11:20		17.6	7.8		10.9	114	14	2.7	< 20		< 1	0.06	0.05	21	< .15	< .15	29	10
24/08/2004	11:05		20.3	7.6		8.4	93	18	1.6	< 20		1.4	0.1	0.08	17	0.31	0.17	14	12
20/07/2004	12:20		23.0	7.8		10.8	121	8	1.5	< 20		< 1	0.09	0.05	18	0.19	< .15	17	8.8
29/06/2004	11:30		22.3	7.7		8.3	95	9	1.4	< 20		1.4	< .05	0.06	19	0.32	< .15	4	2.9
24/05/2004	13:10		20.1	7.8		10.3	113	14	4	< 20		< 1	< .05	0.14	21	< .15	< .15	28	13
10/02/2004	11:10		7.6	7.6		12.1	100	21	2.1	22		< 1	0.11	0.11	32	0.24	< .15	3.2	2.3
16/12/2003	11:15		6.4	7.9		11.2	90	26	2.6	< 20		< 1	0.06	0.11	33	0.28	< .15	3.1	5.1
21/10/2003	11:30		11.9	7.9		10.2	95	12	3.8	< 20		< 1	< .05	0.07	17	< .15	< .15	23	9.3
23/09/2003	11:30		22.2	8.0		9.1	97	15	3.1	< 20		< 1	< .05	0.08	12	< .15	< .15	25	17
19/08/2003	11:25		22.2	7.6				30	3.8	< 20		1.4	< .05	0.13	6	< .15	< .15	114	27
22/07/2003	11:50		22.2	8.0		13.7	164	18	4.1	28		< 1	< .05	0.1	13	< .15	< .15	42	15
17/06/2003	12:30		22.2	7.7		7.3	87	10	3.4	< 20		< 1	< .05	0.07	22	0.26	0.17	15	9
27/05/2003	11:30		22.2	7.6		9.7	101	22	3.6	< 20		1.1	< .05	0.05	28	0.19	< .15	9.6	6.1
11/02/2003	11:20		22.2	7.4				16	2.9	33		< 1	< .05	0.1	24	0.33	< .15	< 1	4.9


Qualité des eaux


Station : RIGNY-USSE


Code : 04075200


Cours d'eau : INDRE


Date prél.	Heure	Débit m3/s	T°eau °C	pH	Cond.25° µS/cm	O2 dis. mg/l	Sat. O2 %	MES mg/l	DBO5 mg/l	DCO mg/l	COD mg/l	N Kj mg/l	NH4+ mg/l	NO2- mg/l	NO3- mg/l	PO4--- mg/l	P Total mg/l	Chloro. a µg/l	Phéopig. µg/l
10/12/2002	12:15		22,2	7,7	480			31	3,2	< 20		1,1	0,08	0,13	29	0,29	< .15	1,9	4,8
22/10/2002	12:30		22,2	8,2	516			23	3,4	29		2,2	< .05	0,06	17	< .15	< .15	68	13
24/09/2002	12:15		22,2	7,9	519	9,2	95	26	4,3	28		1,7	< .05	0,05	14	< .15	< .15	74	33
19/08/2002	12:15		22,2	7,9	507	10,5	123	29	9	< 20		2,8	0,54	0,07	12	< .15	< .15	129	35
23/07/2002	11:40		22,2	7,8	518	10,5	124	21	3,7	42		2	< .05	0,09	17	< .15	< .15	33	9,7
25/06/2002	12:20		22,2	8,0	512	7,6	88	19	3	< 20		1,7	0,08	0,06	23	0,26	< .15	8,5	7,9
28/05/2002	12:00		22,2	8,7	533	9,1	94	20	2,5	< 20		1,1	< .05	0,08	21	0,29	< .15	14	12
12/02/2002	10:50		22,2	7,8	481	11,1	99	21	2	< 20		1,7	< .05	0,1	25	0,23	< .15	16	6,6
17/12/2001	12:25		22,2	8,0	503	12,8	91	5	2,7	< 20		1,1	0,13	0,13	27	0,3	< .15		
23/10/2001	14:30		22,2	7,9	491	9,3	96	35	2	< 20		< 1	0,13	0,11	19	0,31	< .15	11,9	8,2
25/09/2001	12:05		22,2	8,1	531	10,8	110	16	4	< 20		< 1	0,06	0,05	24	< .15	< .15	29,9	14,2
21/08/2001	12:10		22,2	8,0	513	9,0	102	10	3	< 20		< 1	0,08	0,08	23	0,17	< .15	21	9,8
24/07/2001	12:35		22,2	7,9	497	8,4	96	13	4	23		< 1	0,05	0,05	26	0,2	< .15	16,3	7,8
26/06/2001	11:55		22,2	8,1	506			17	4	< 20		1,1	0,03	0,07	30	< .15	< .15	7,4	2,5
29/05/2001	12:00		22,2	8,0	473	10,8	120	20	6	< 20		1,4	0,05	0,07	28	< .15	< .15	36,3	15,6
16/02/2001	11:40		9,0	7,6	410	10,9	94	42	4	27		1,4	0,13	0,17	21	0,34	0,2	1,1	5,8
12/12/2000	12:10	24,100	10,9	8,9		10,5	94	39	4	35		1,4	0,08	0,14	25	0,22	< .2		
17/10/2000	12:00	6,520	22,2	8,9		9,5	88	16	2	< 20		1,1	0,06	0,06	23	0,18	< .2	19,4	7,5
19/09/2000	11:55	3,040	22,2	8,8		9,7	106	25	4	< 20		1,1	0,03	0,05	19	0,09	< .2	55	13
22/08/2000	11:30	3,420	22,2	7,9		9,0	100	18	4	< 20		2	< .01	0,05	18	0,28	< .2	9	6
18/07/2000	11:55	5,650	22,2	7,9		8,3	86	15	2	27		0,6	0,05	0,04	22	0,24	< .2	13,4	7,9
20/06/2000	11:45	5,400	22,2	7,9		9,2	106	18	4	27		1,4	0,08	0,11	24	0,18	0,4	35	13
23/05/2000	11:50	10,500	22,2	7,8		9,5	98	19	2	< 20		2	0,05	0,05	27	0,15	0,3	18,2	12,5
14/02/2000	13:00	22,000	8,6	8,2		11,8	98	84	3	37		2	0,35	0,23	23	0,56	0,26	8	< .5

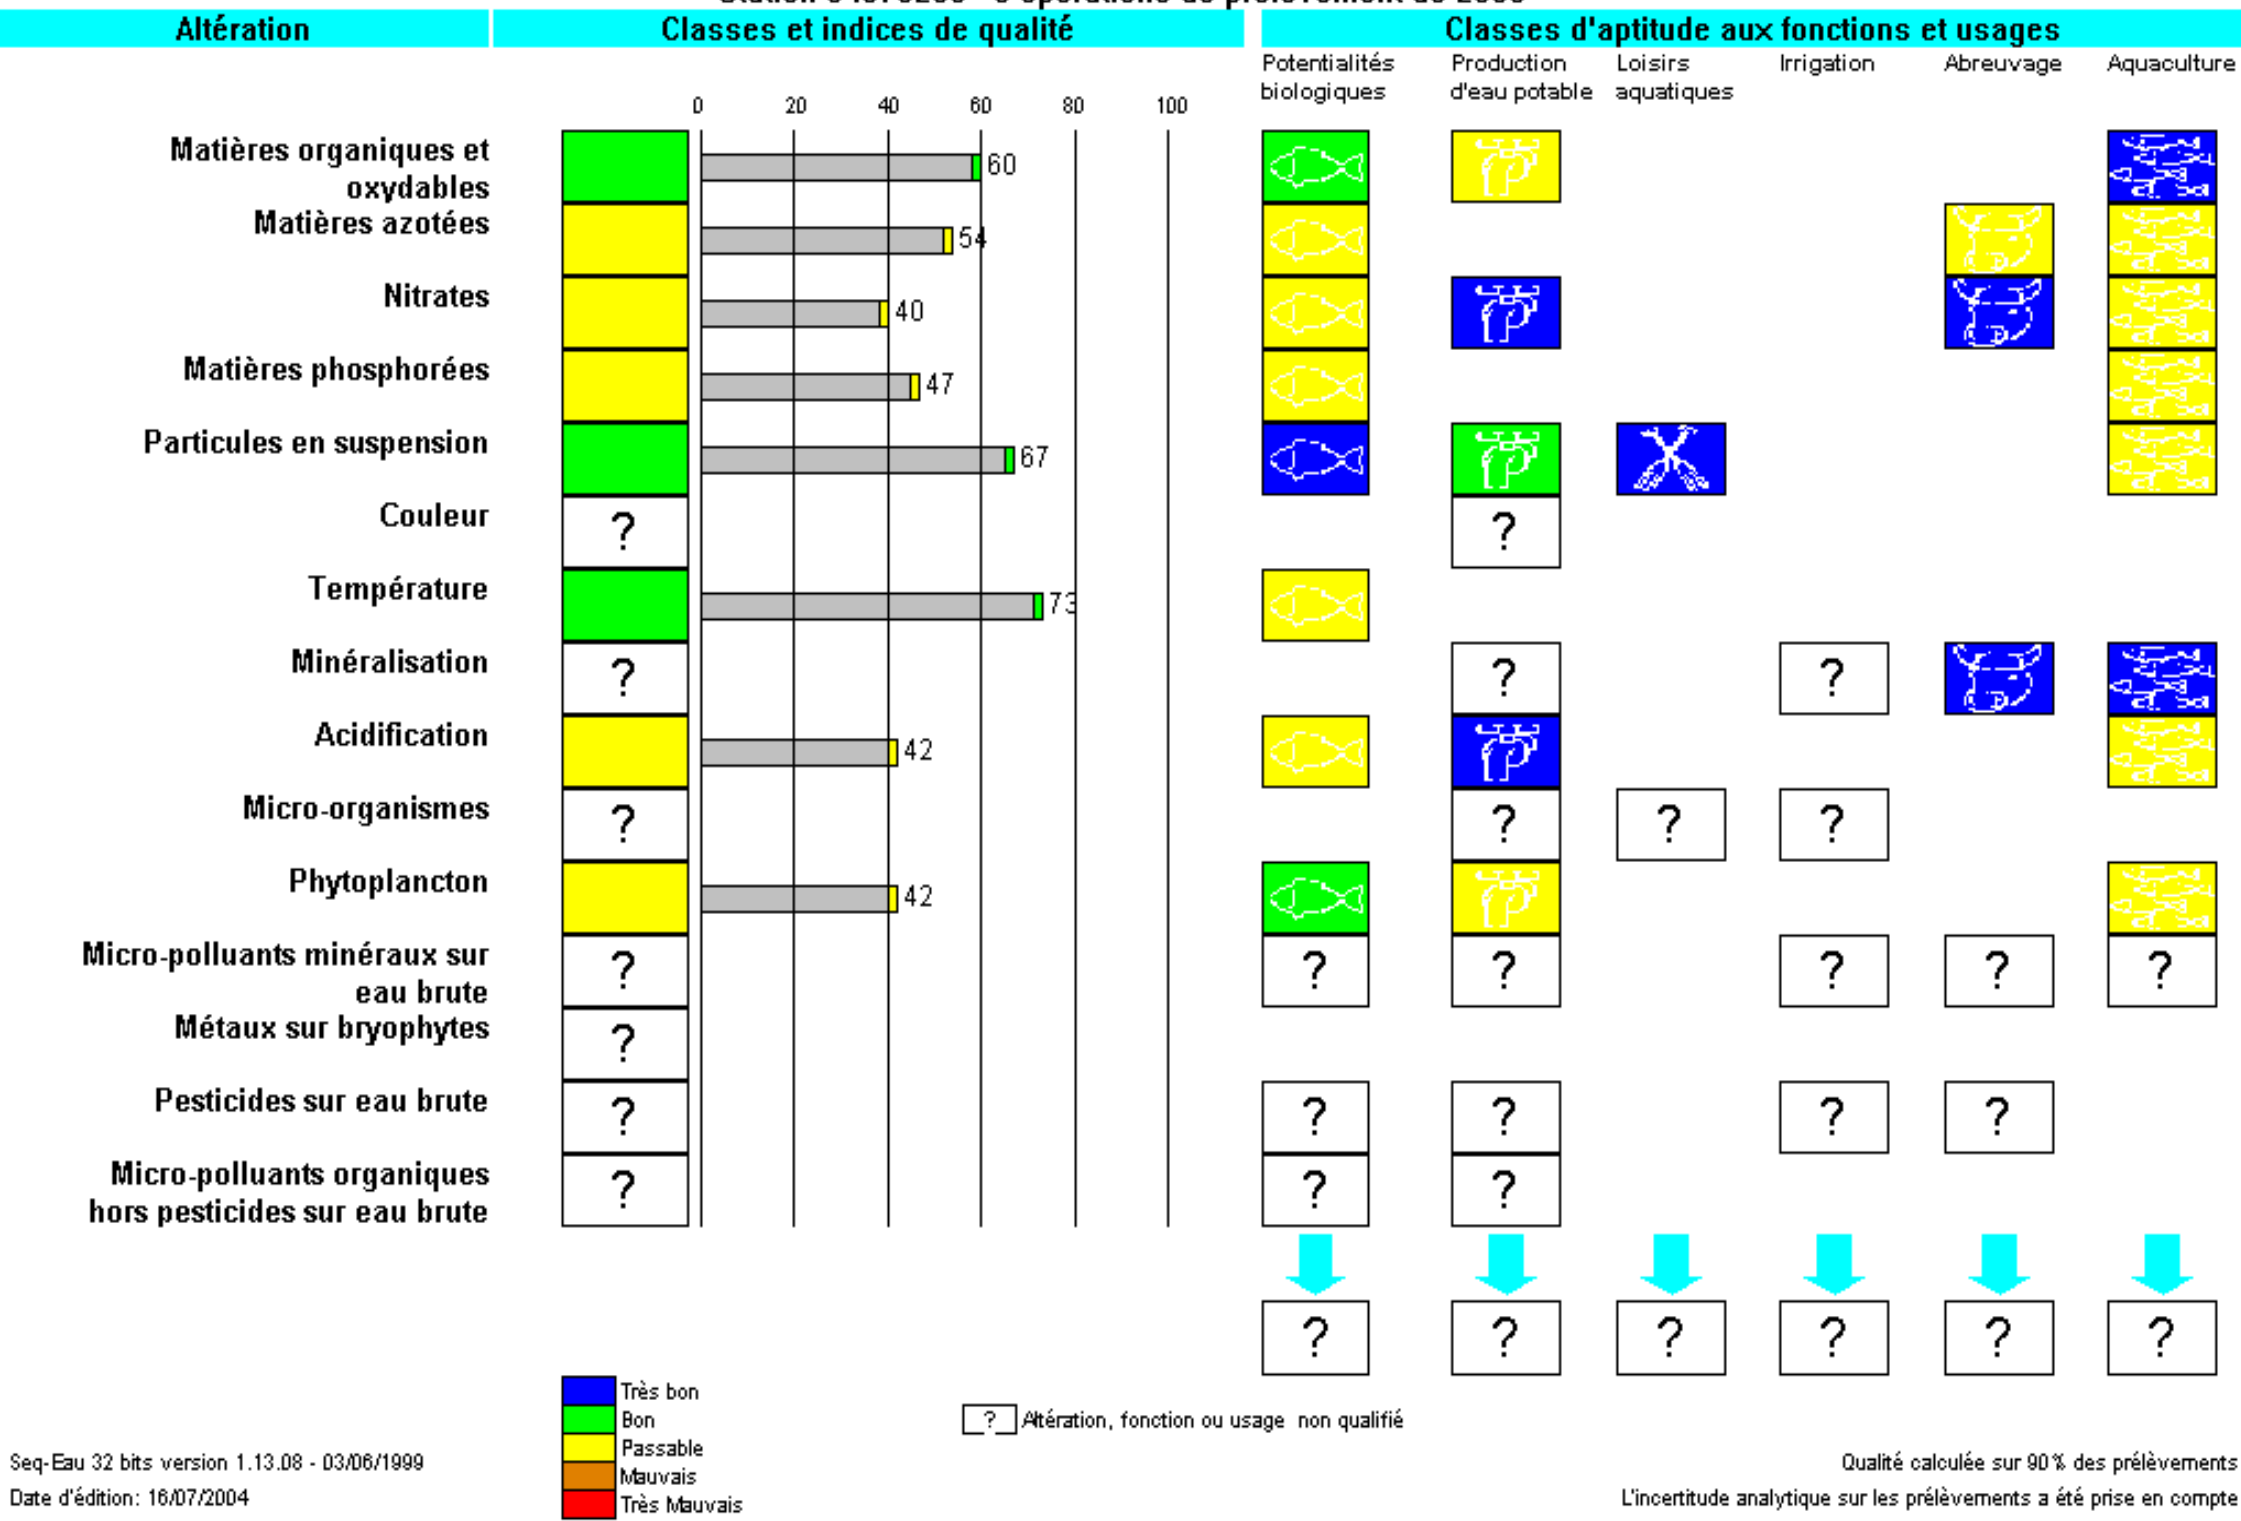


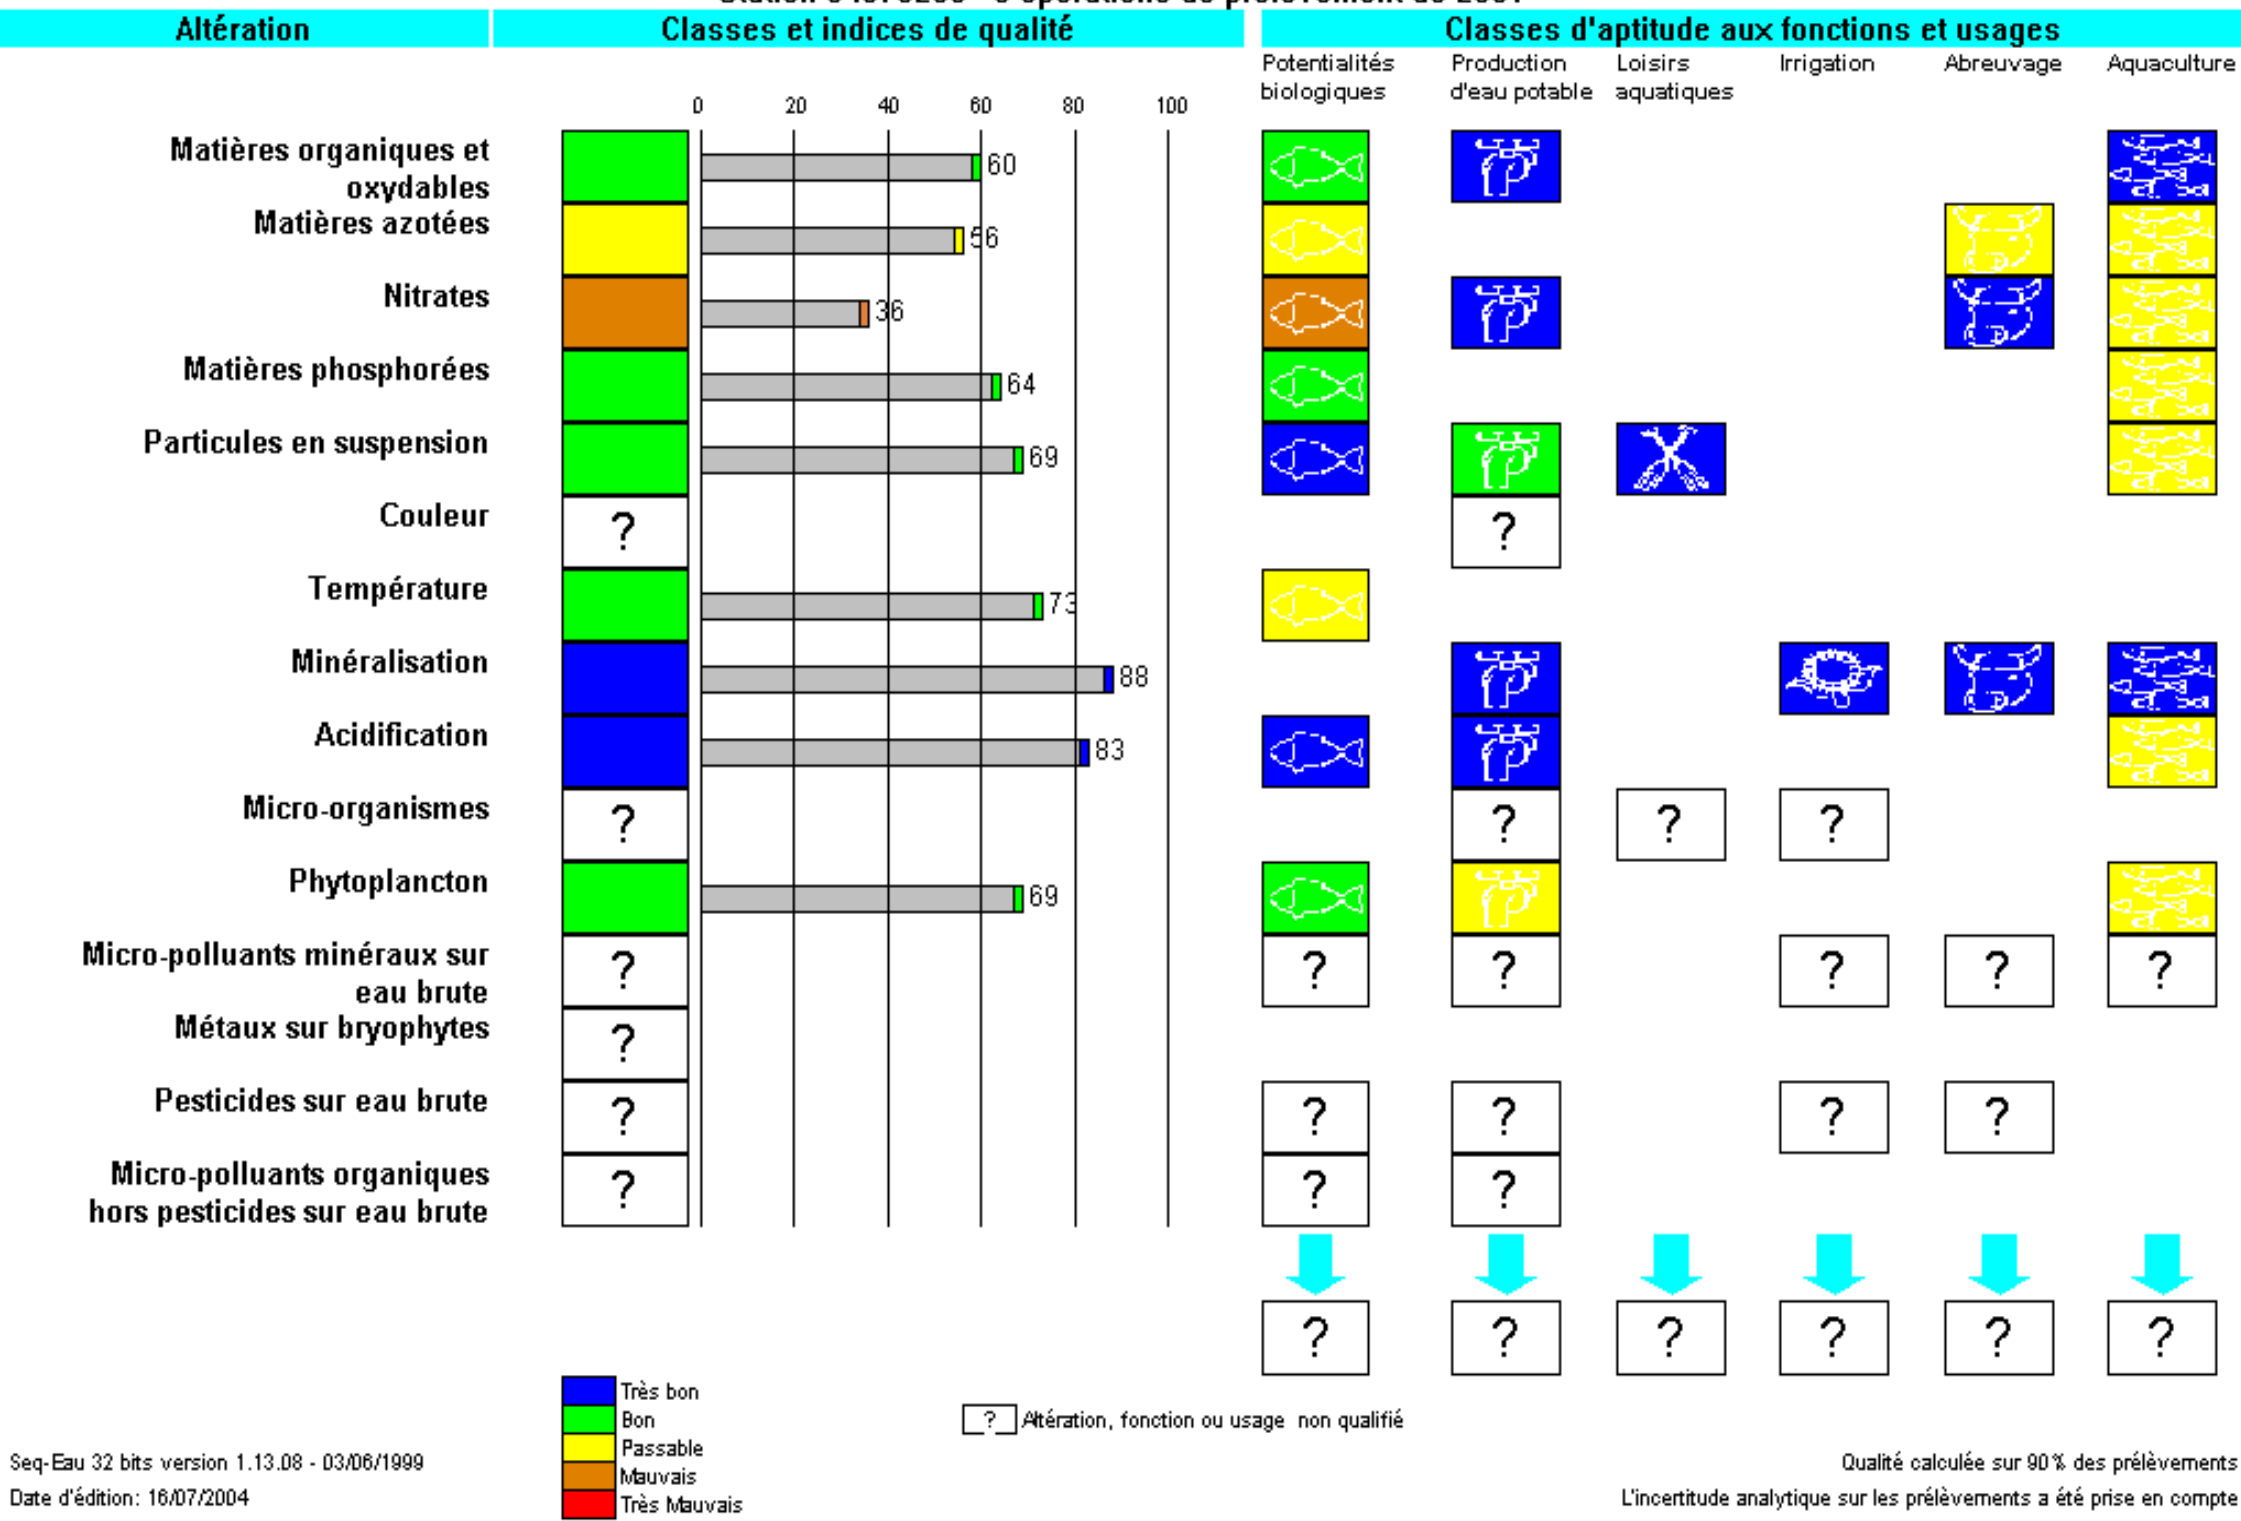


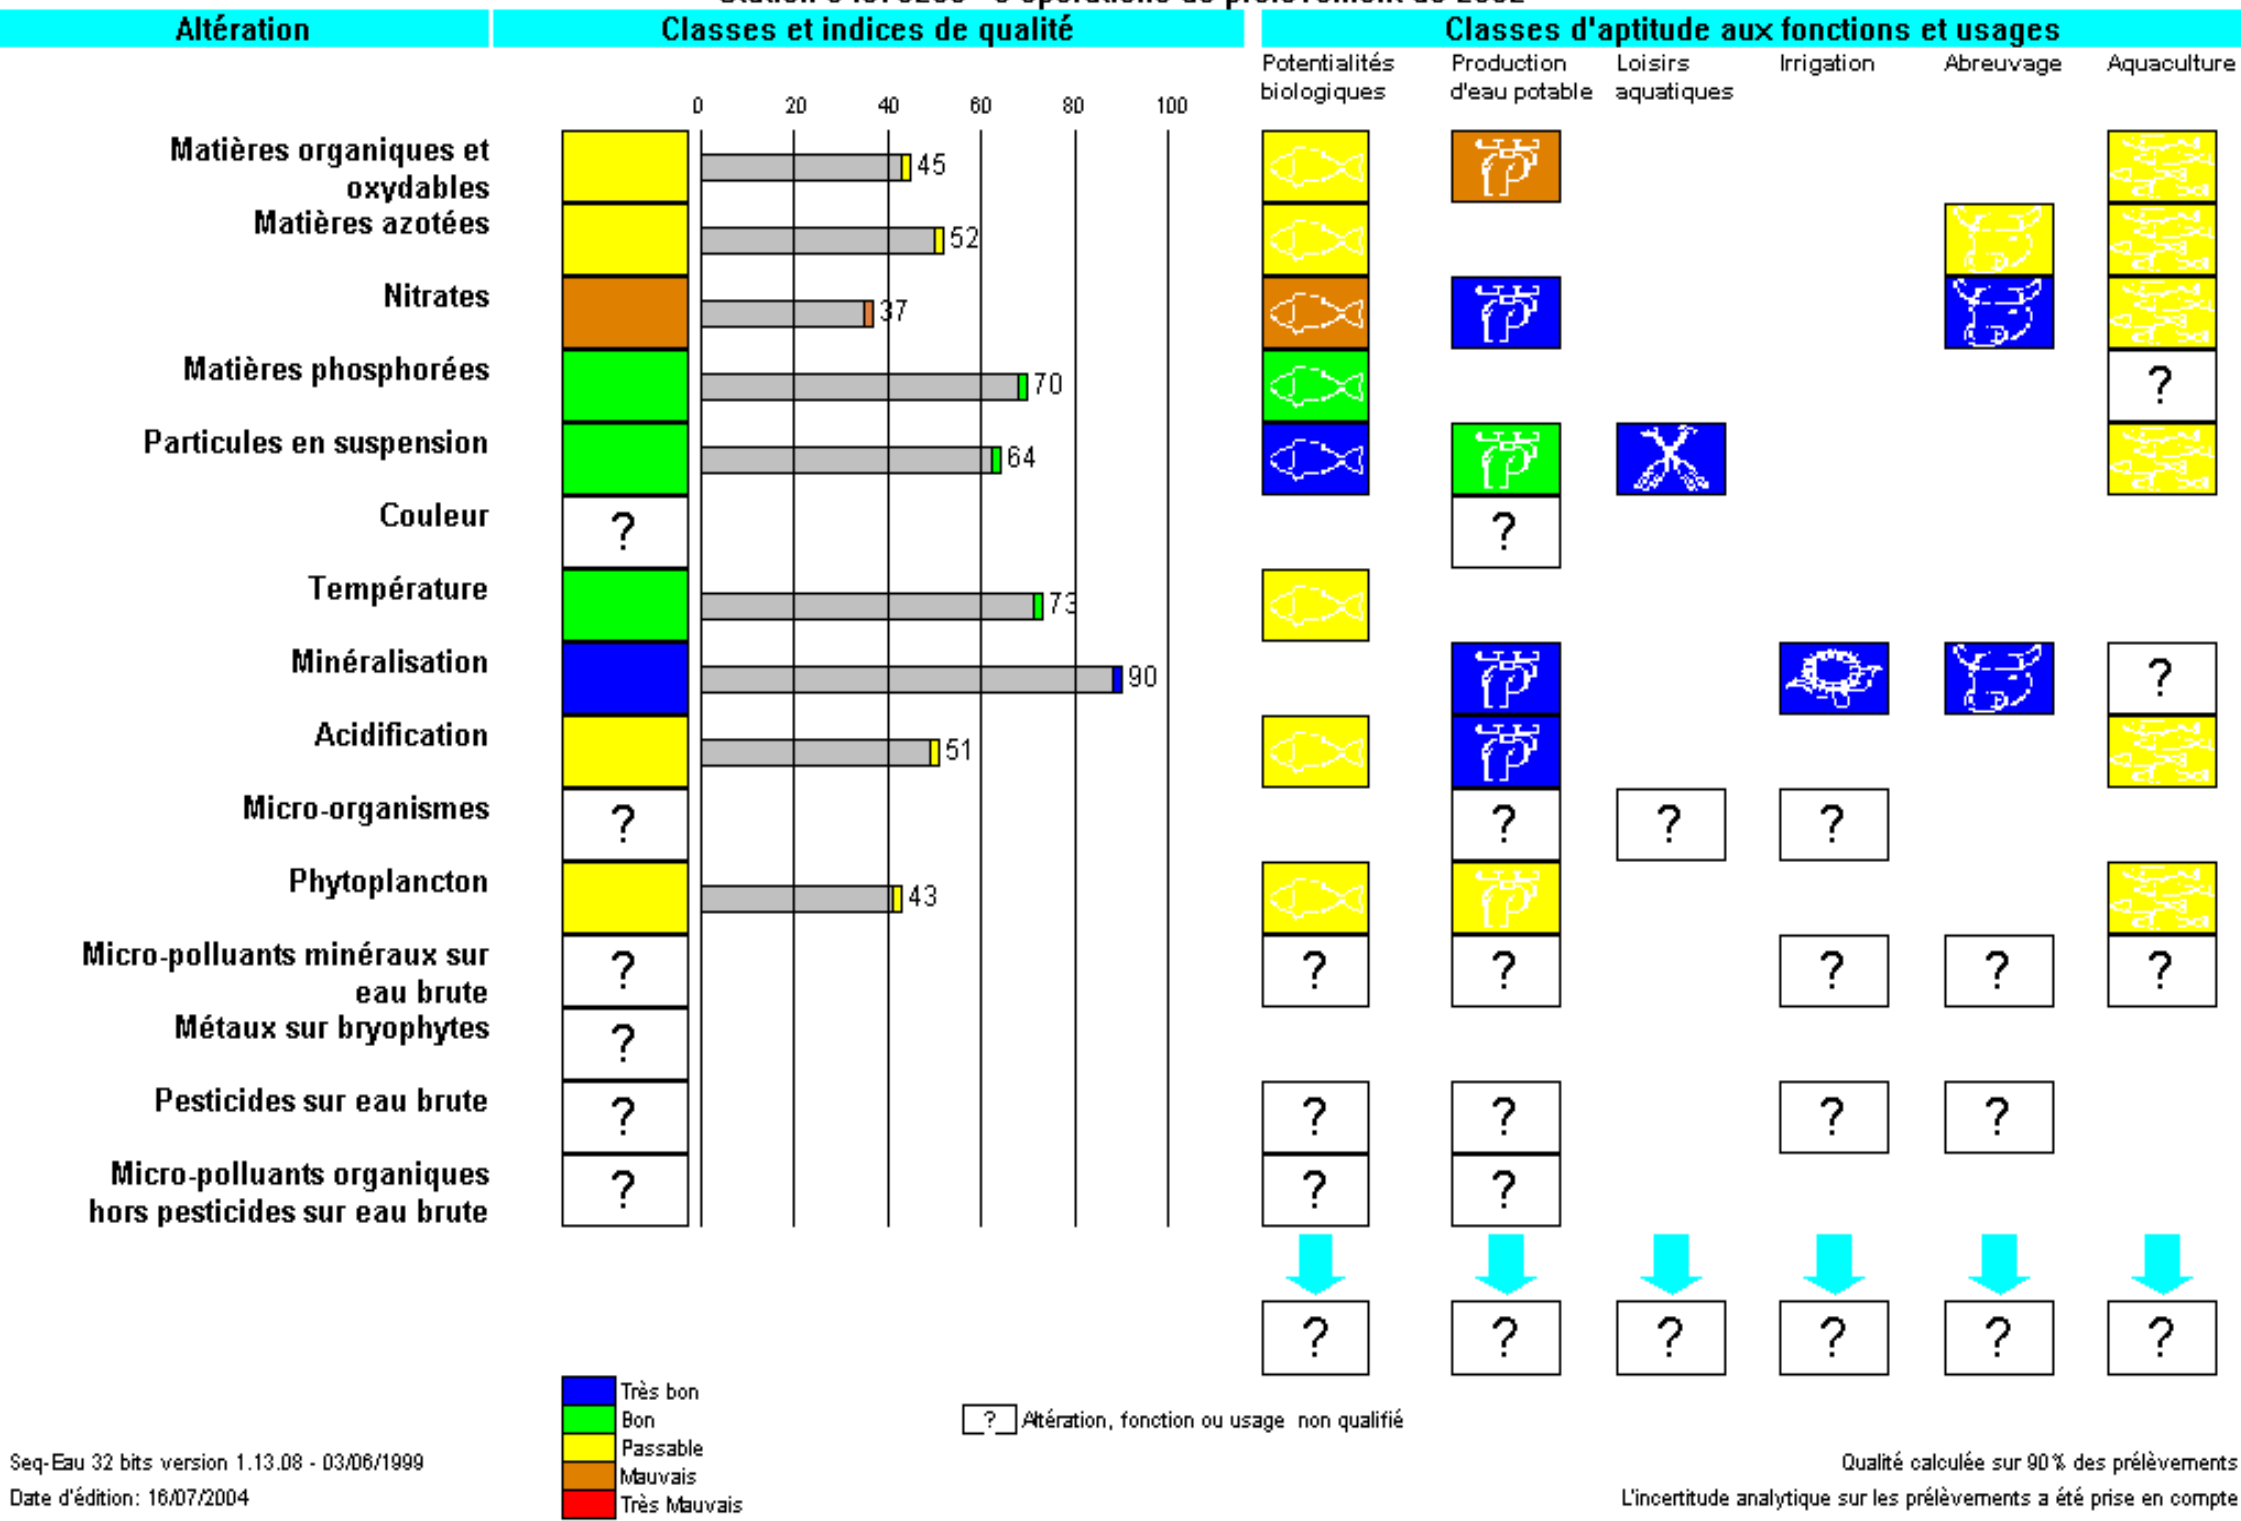


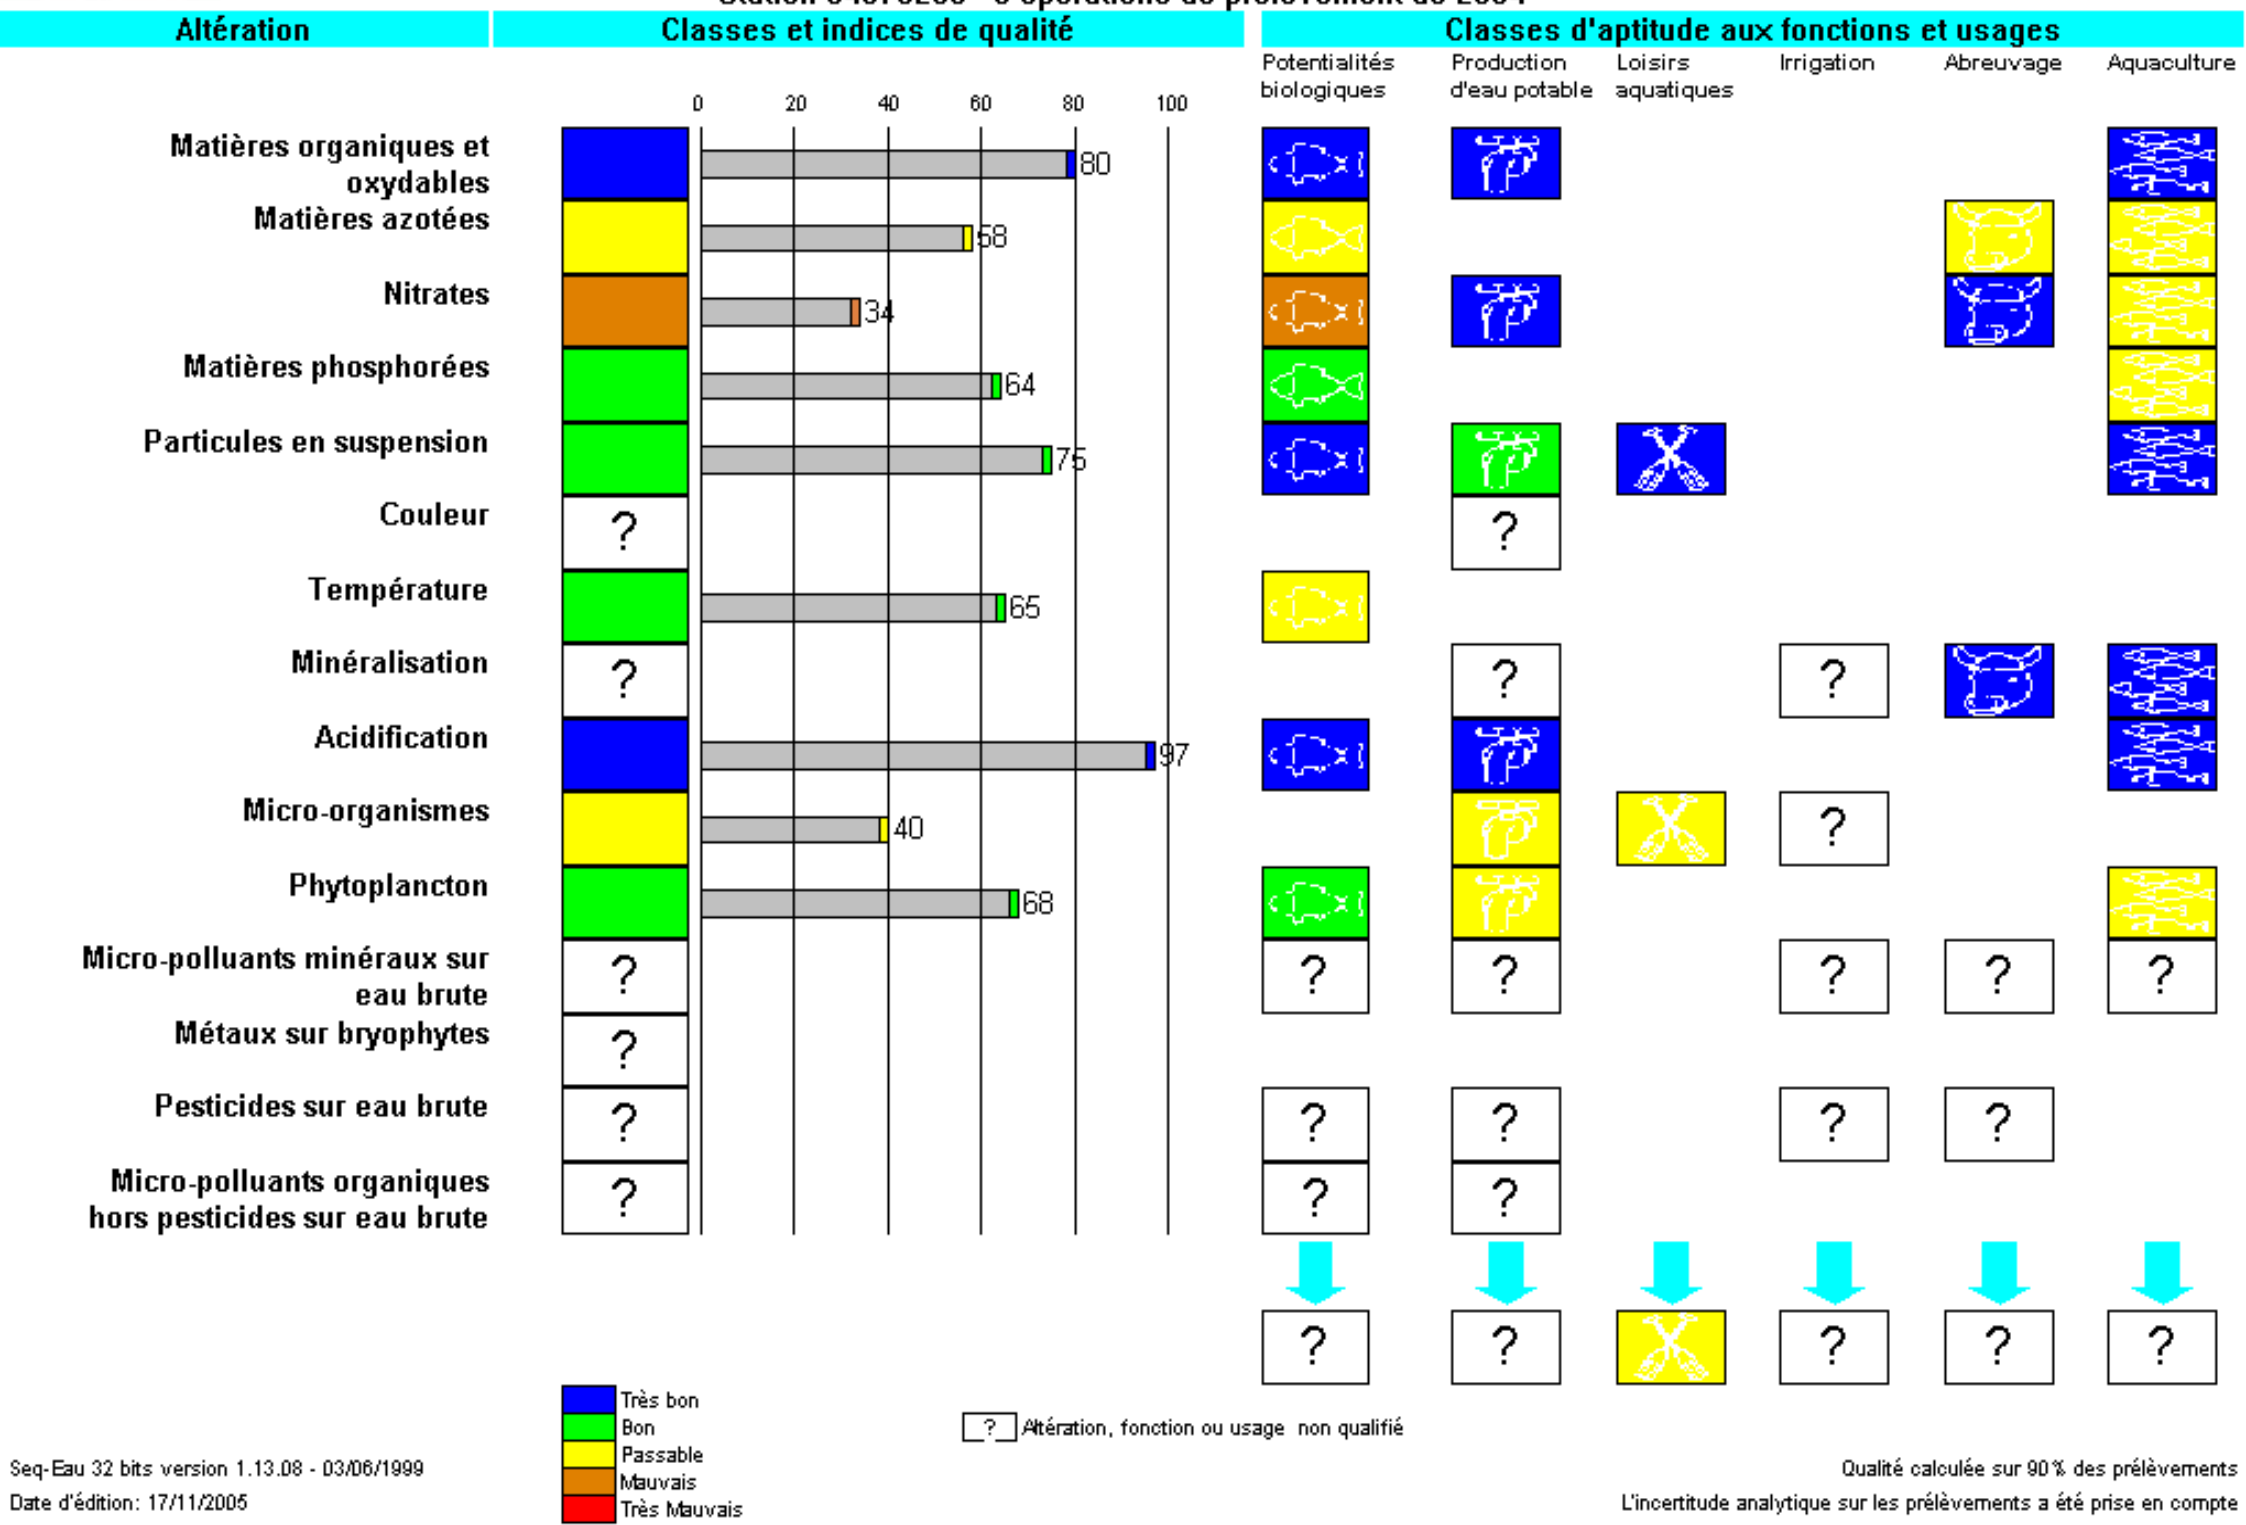

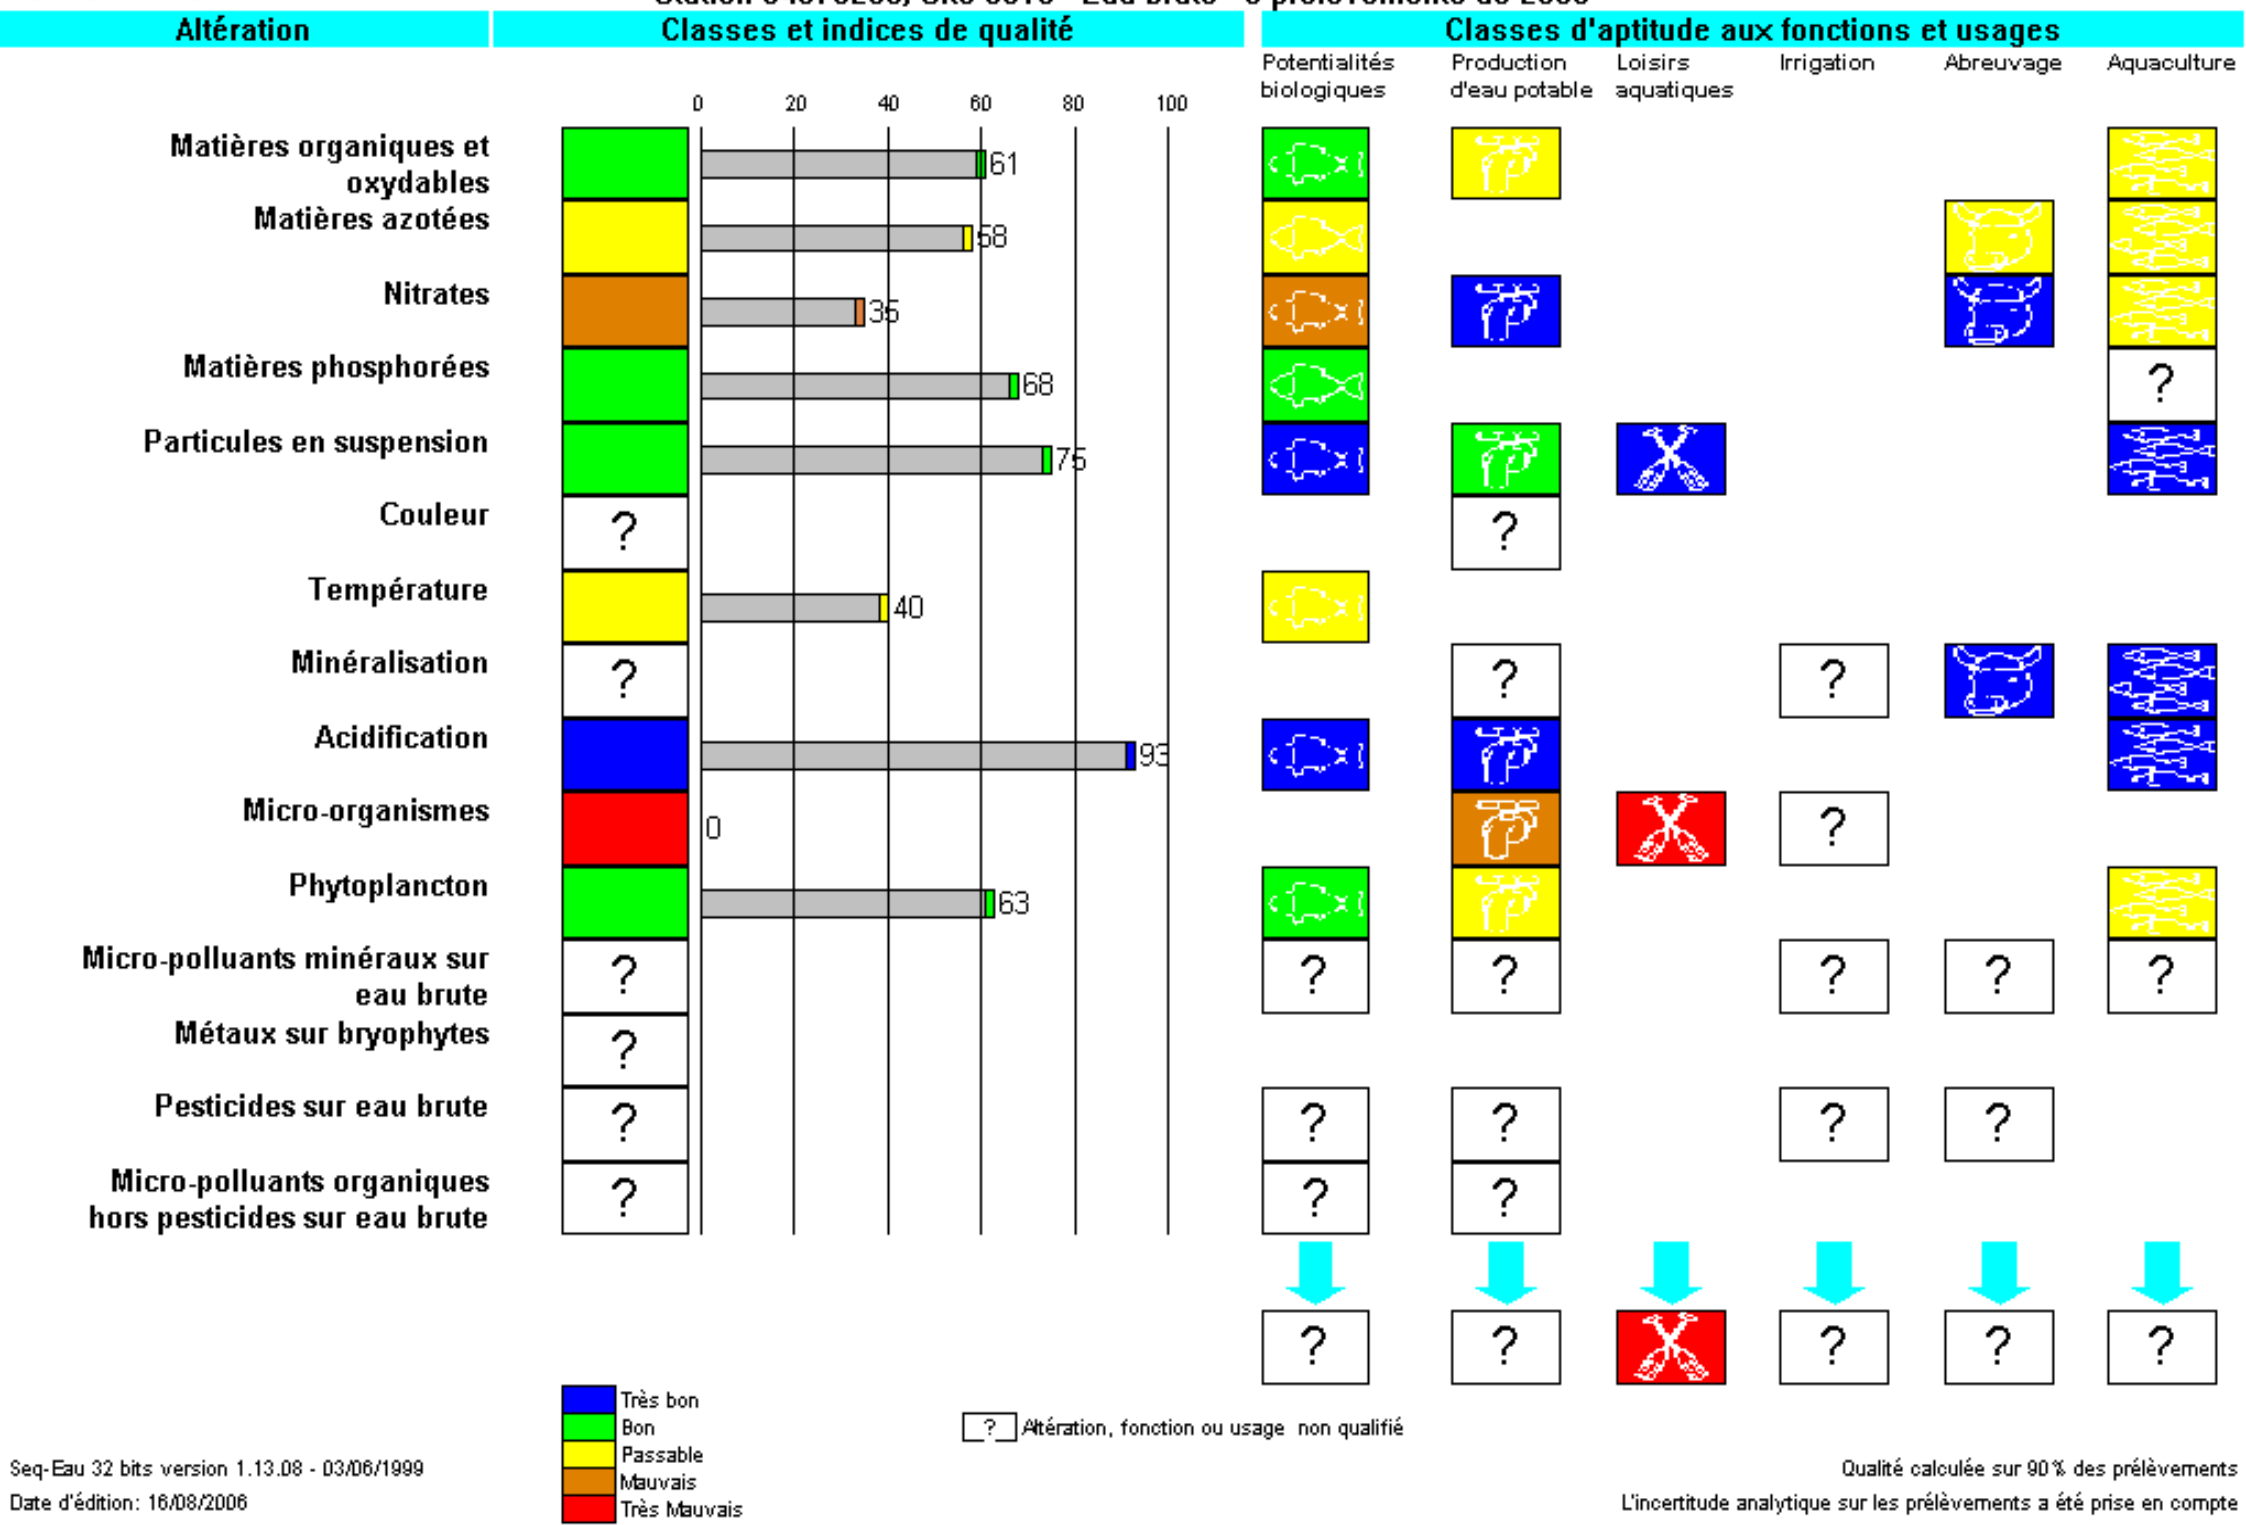

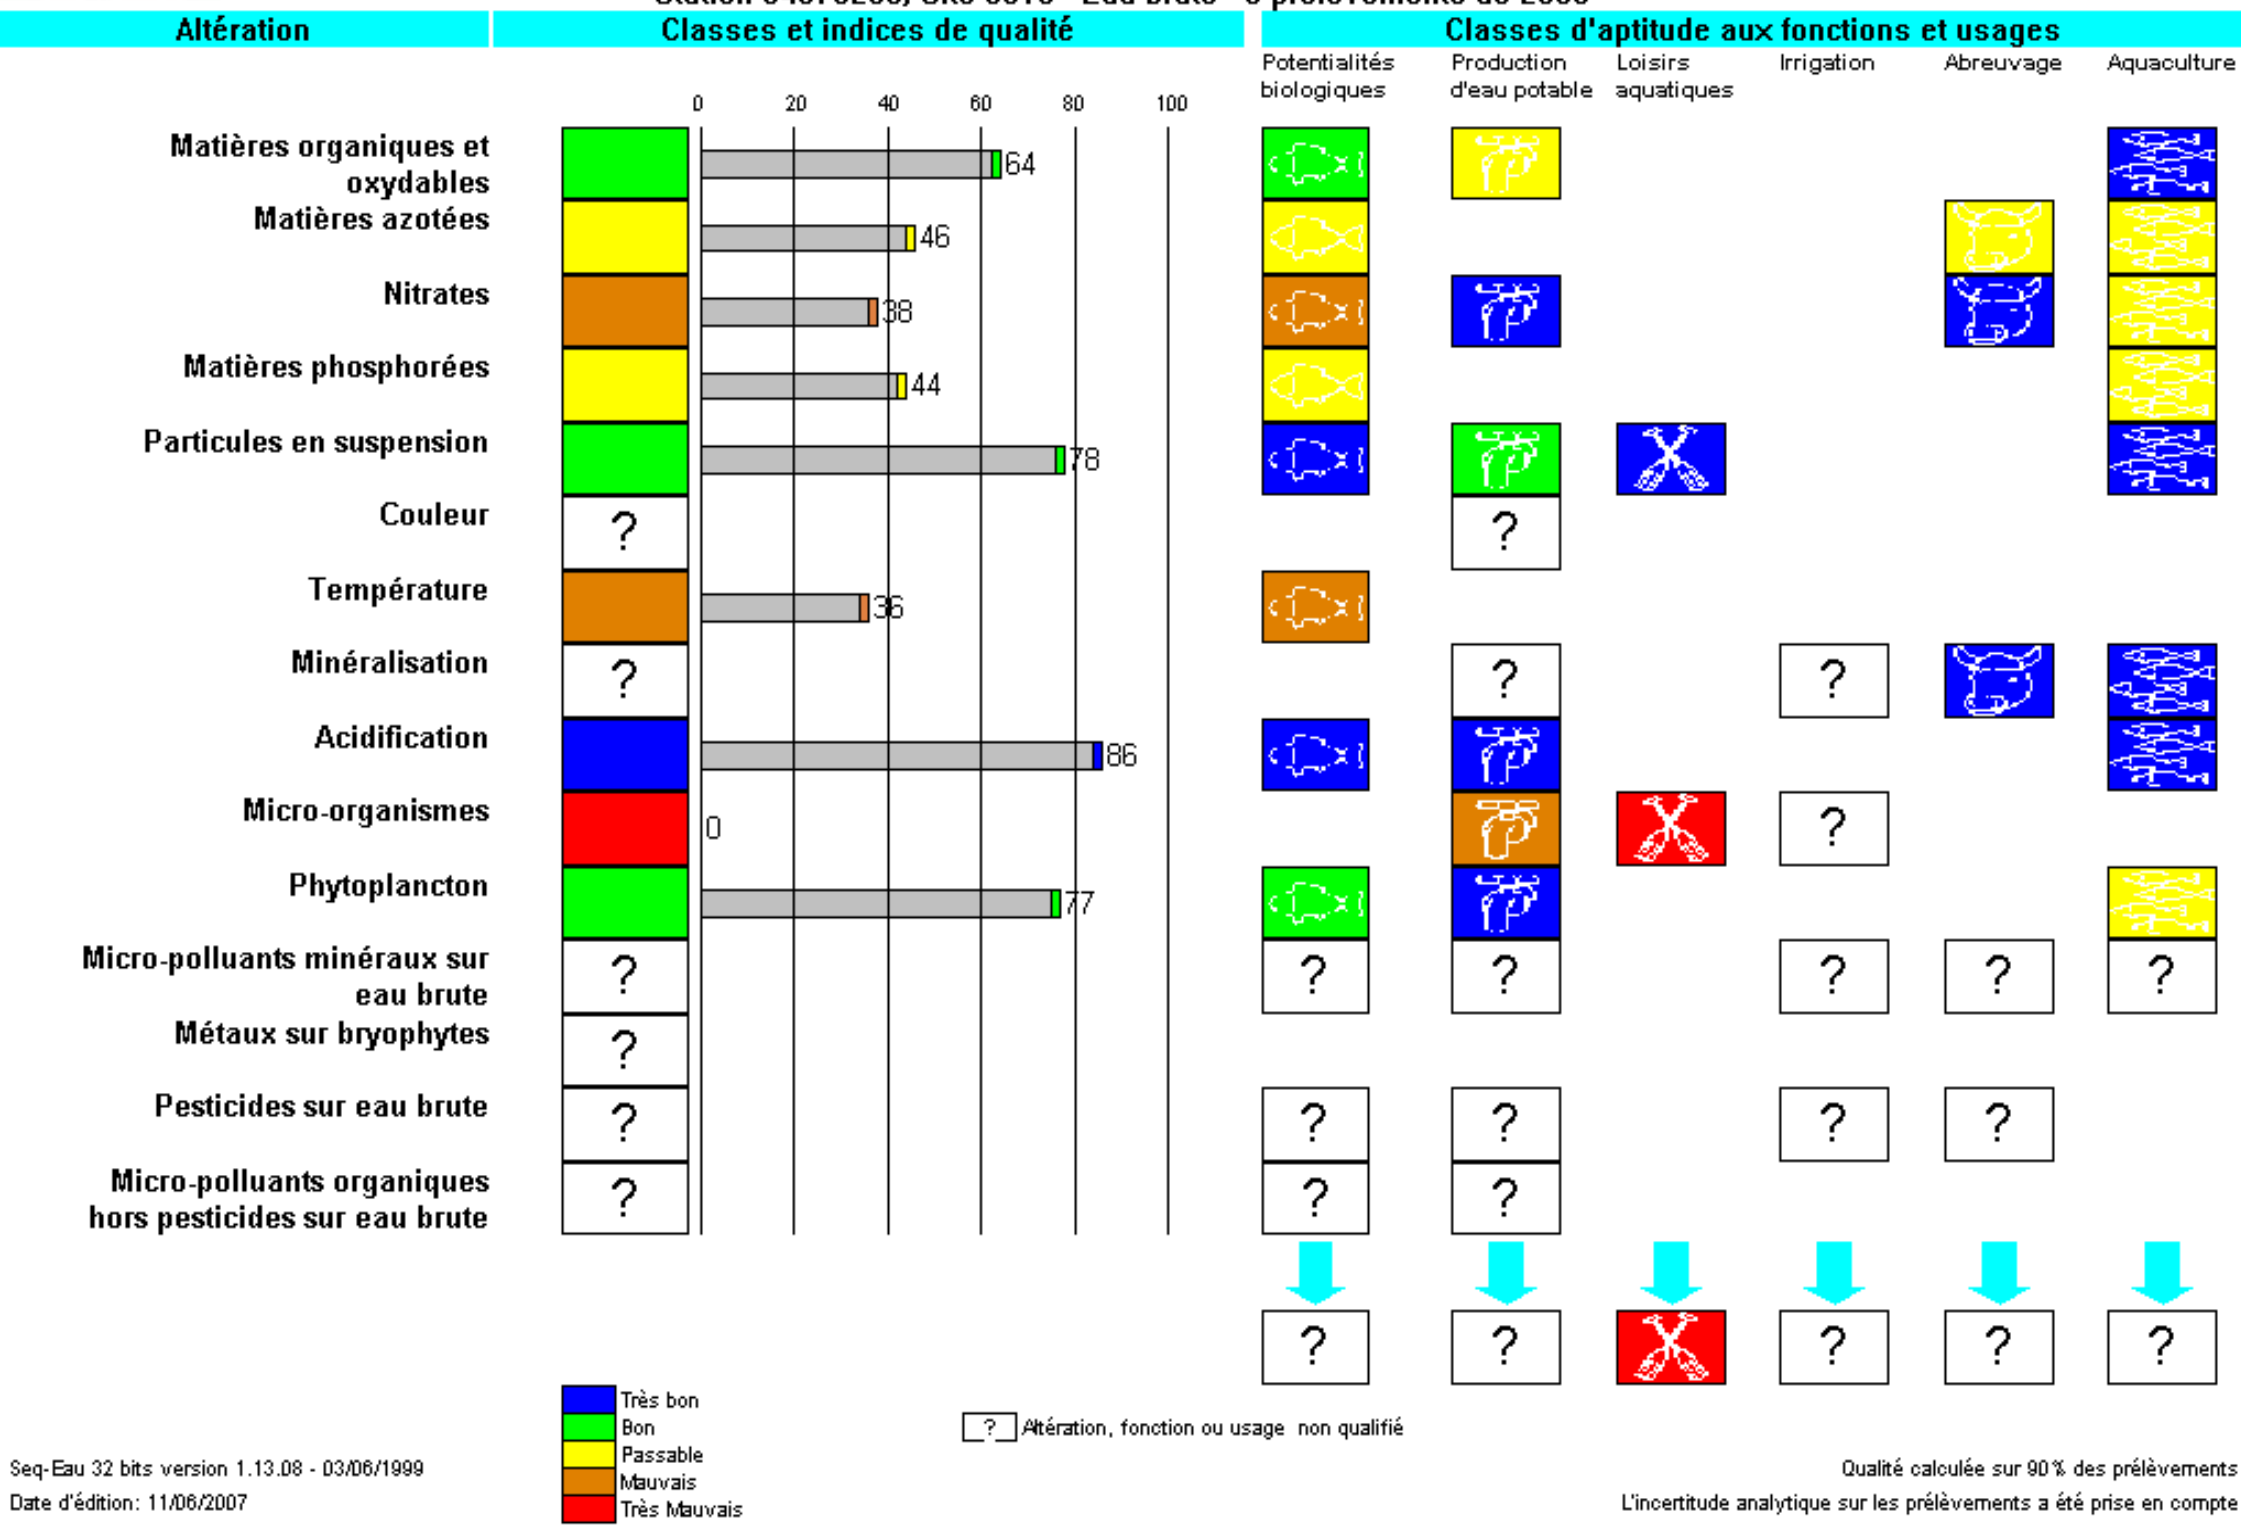

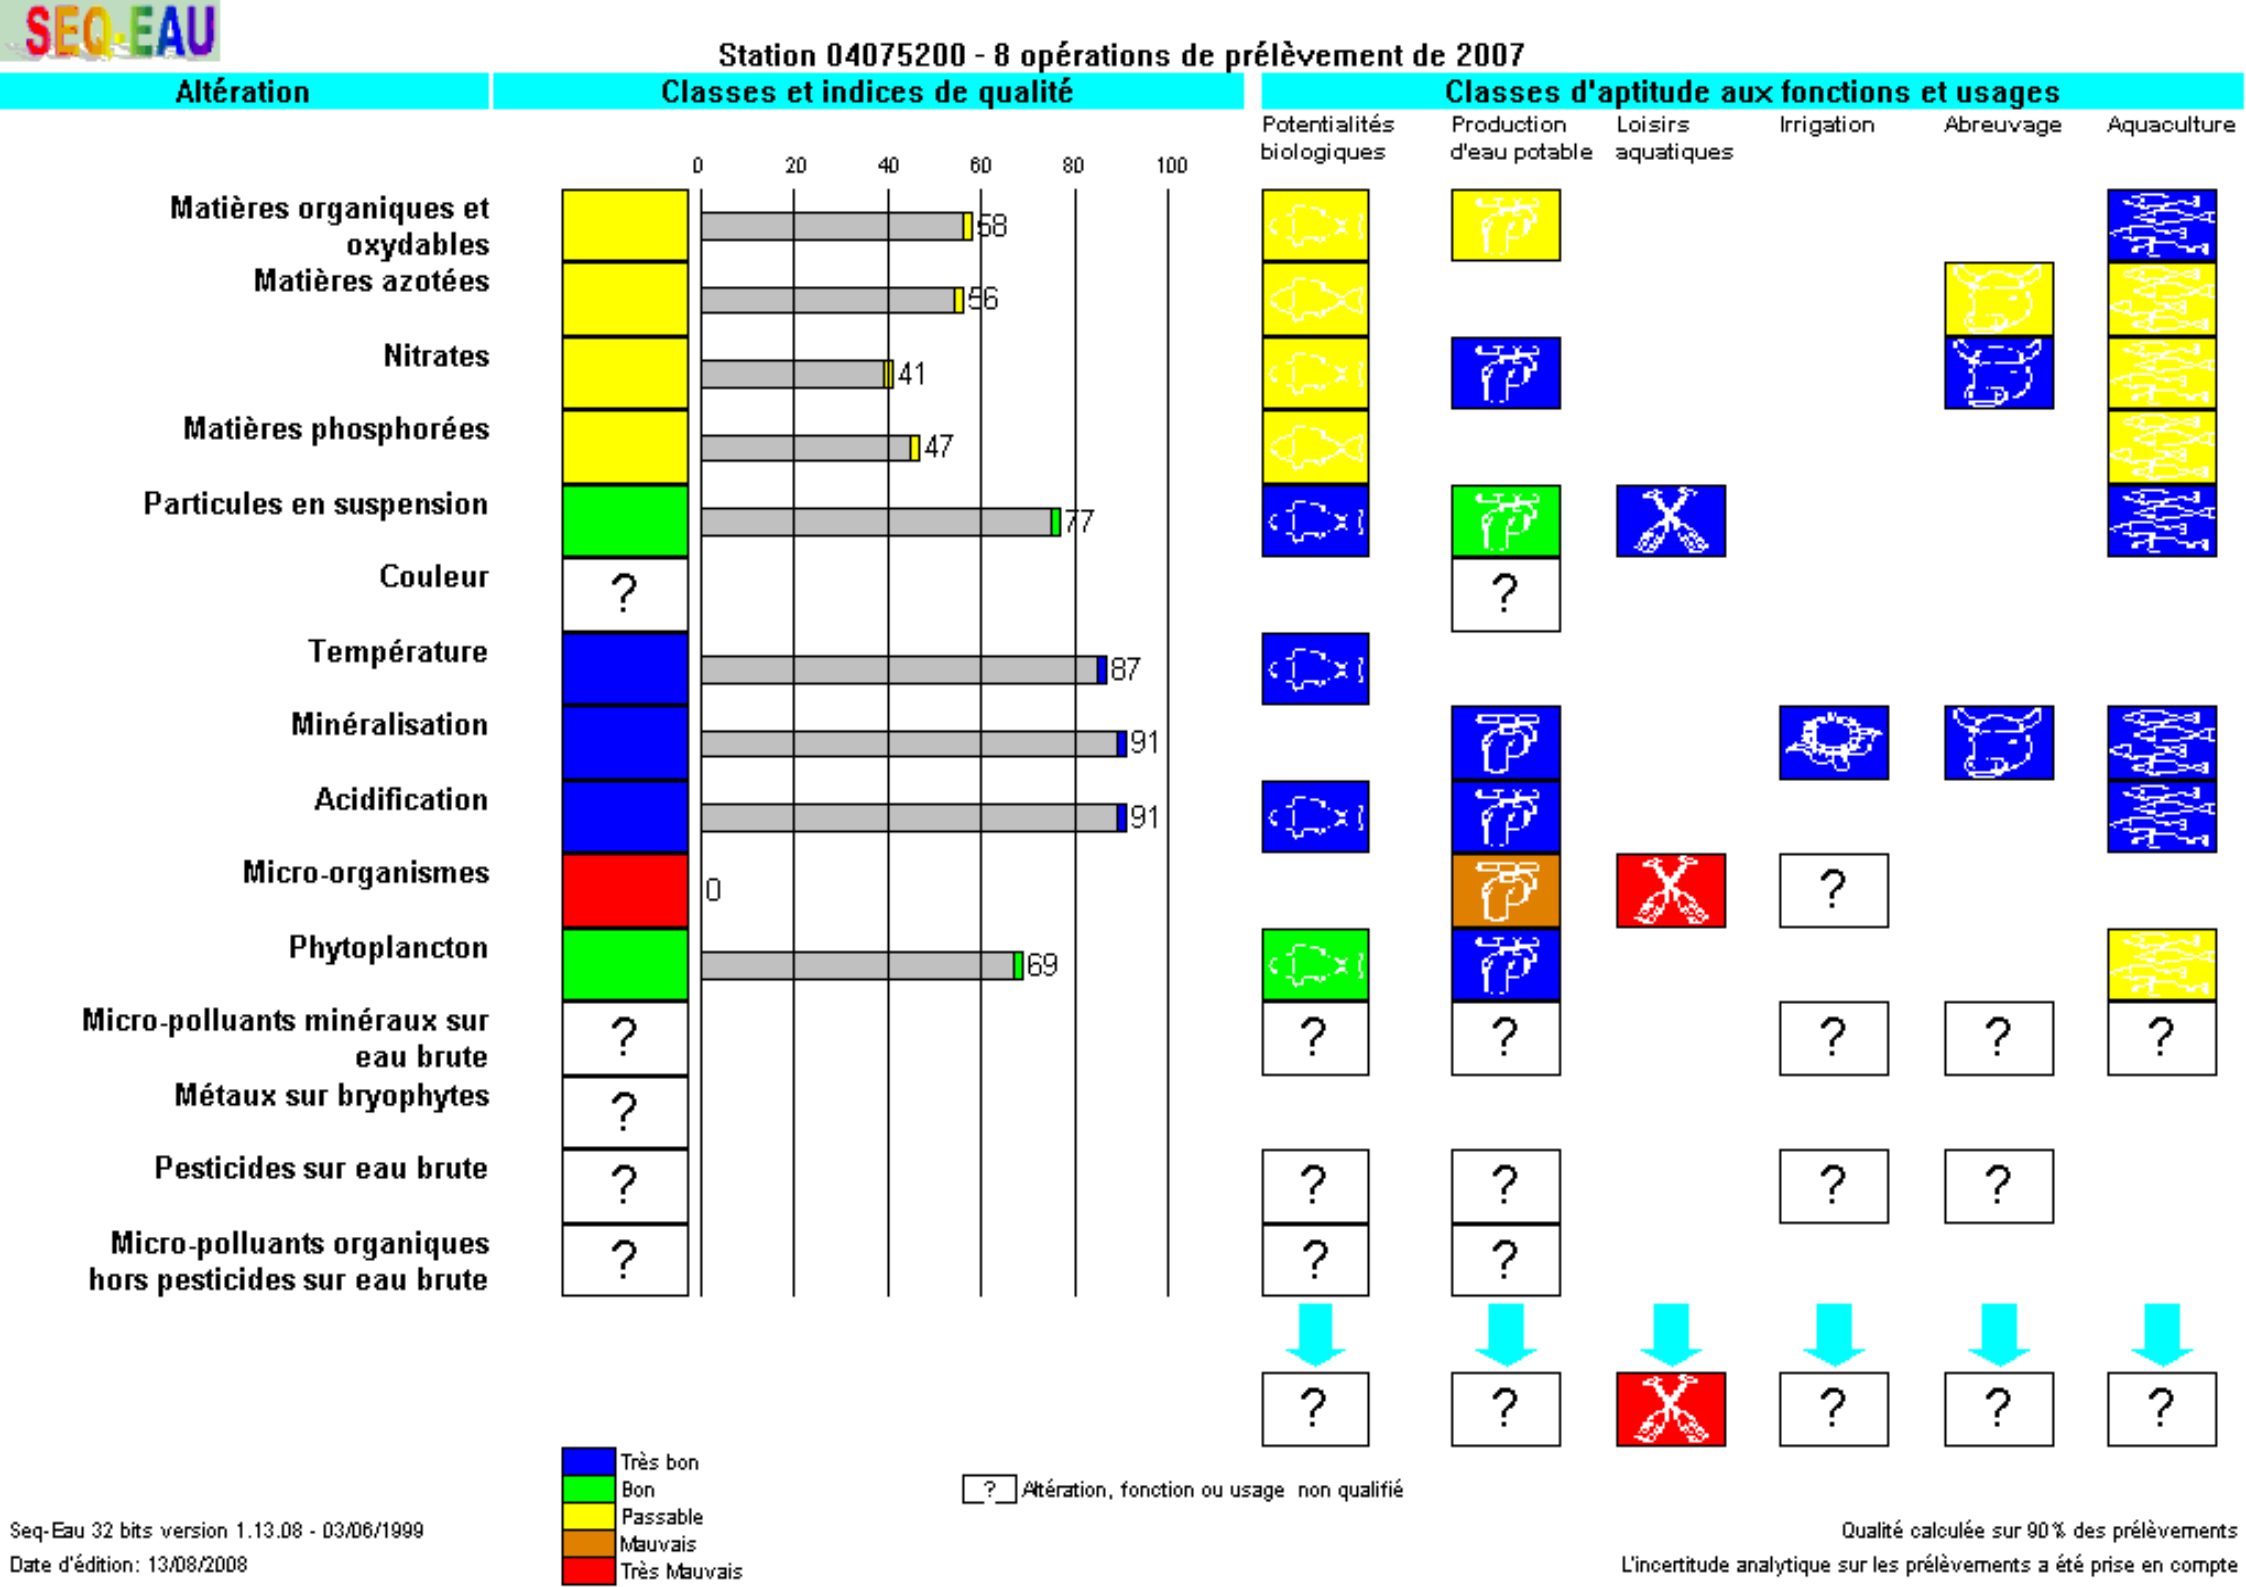

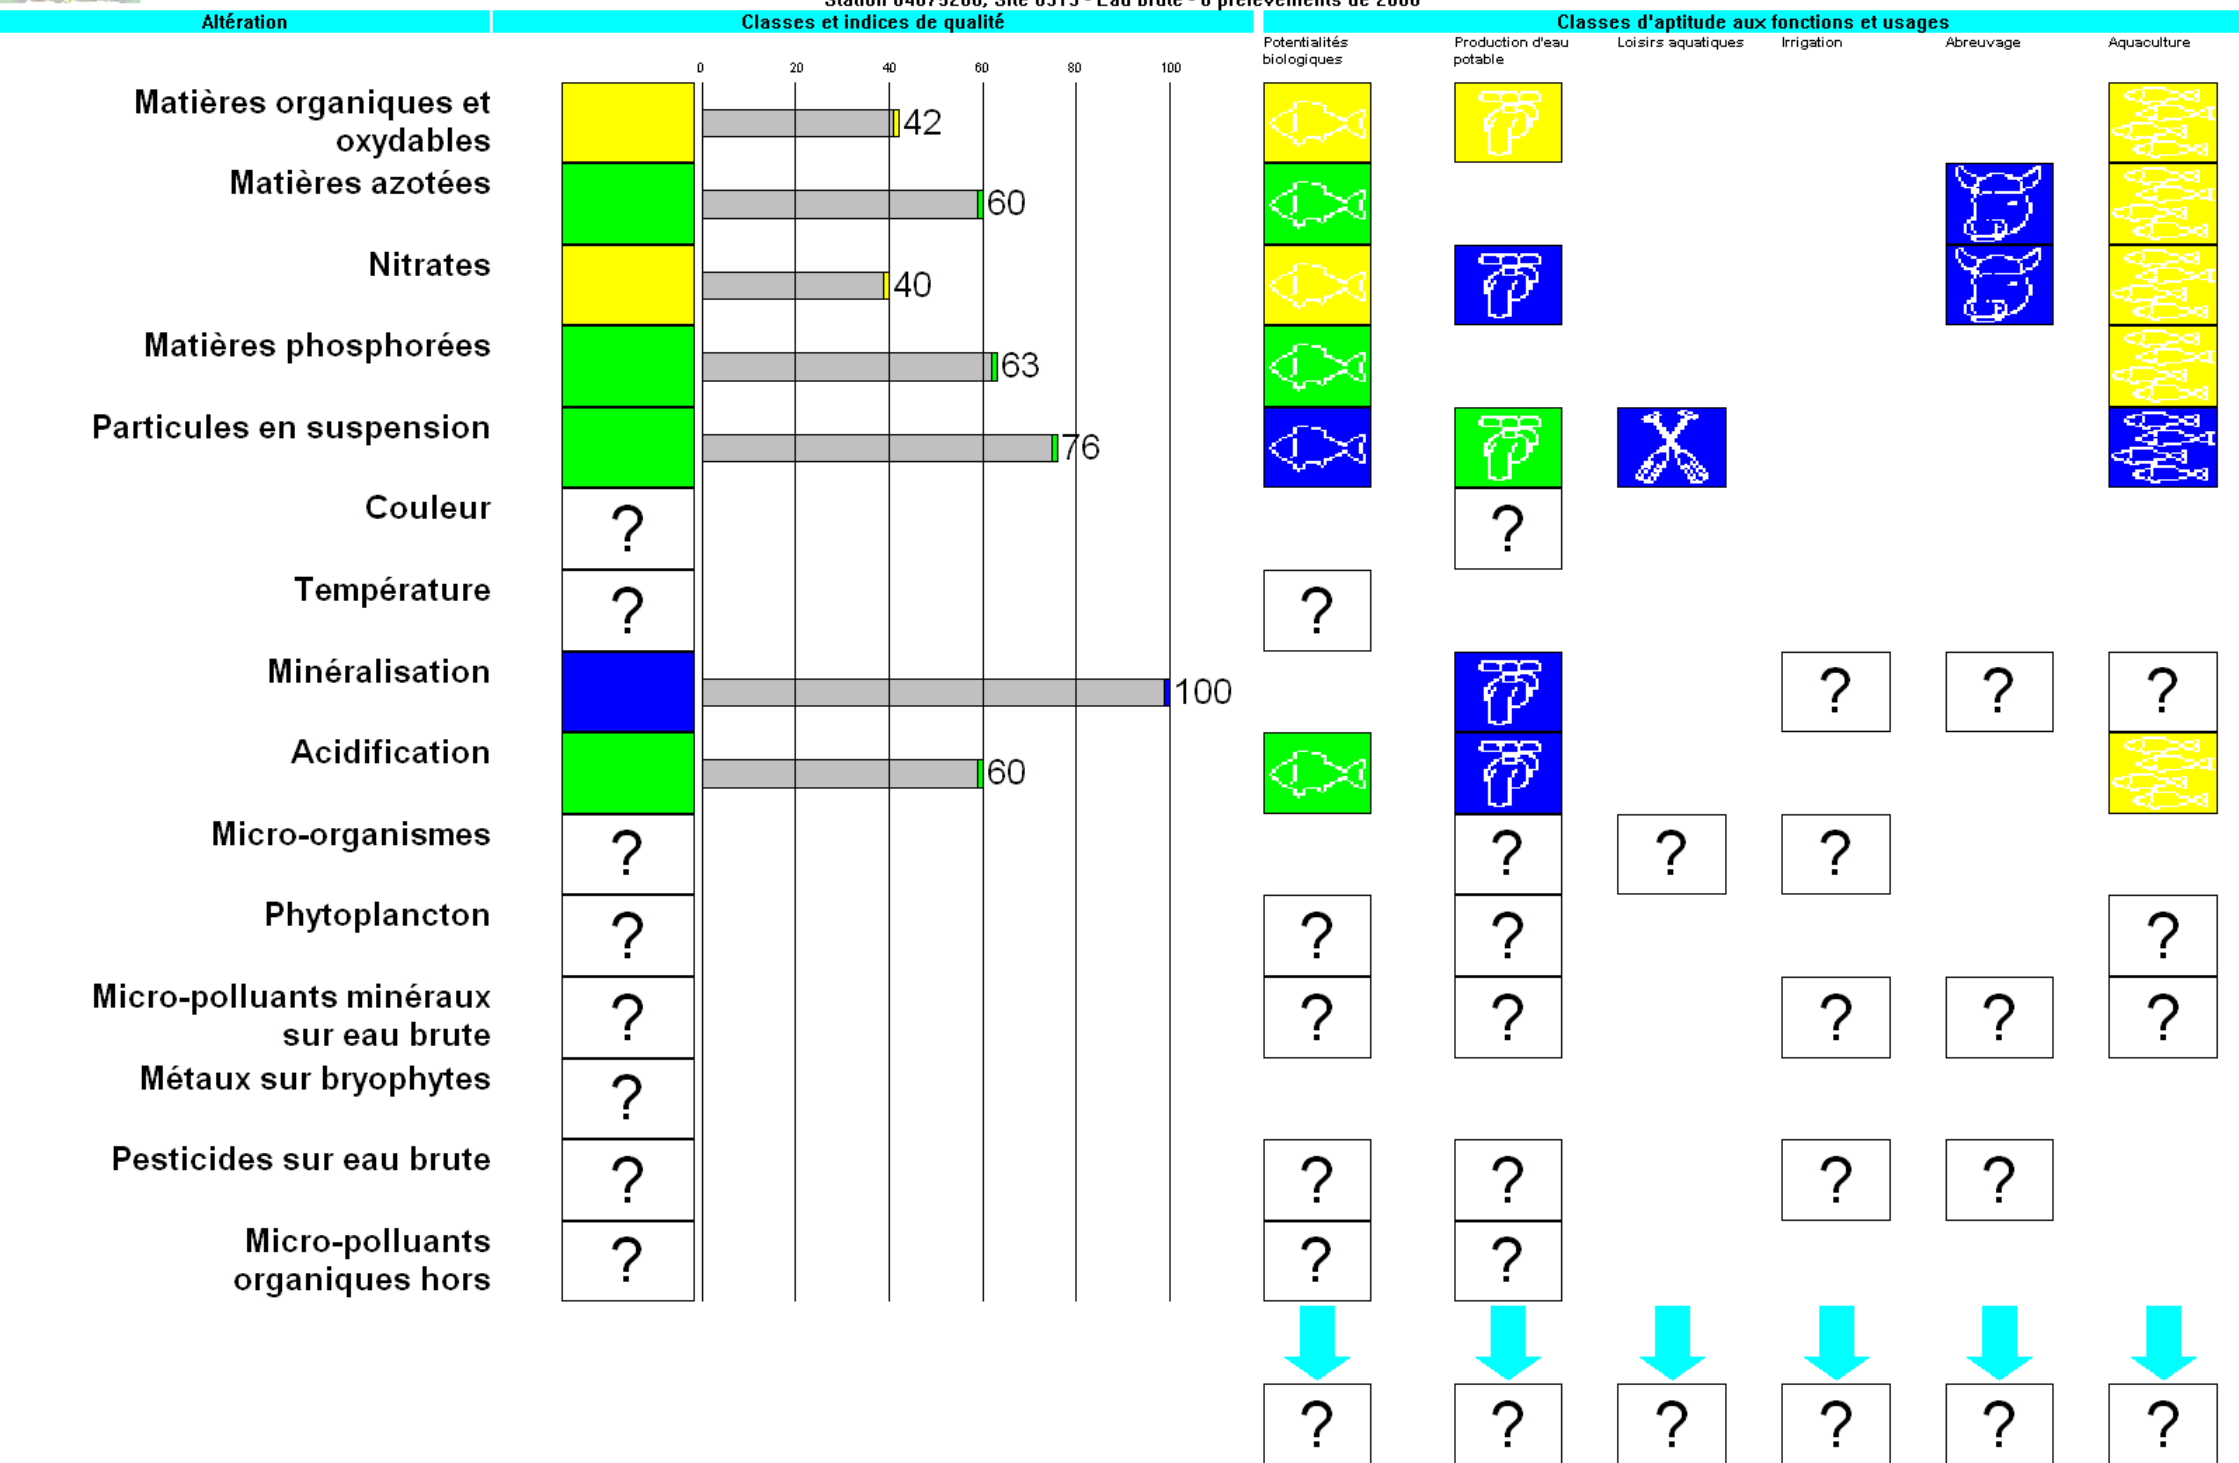

Altération, fonction ou usage non qualifié