

Rivière :

VIENNE

Station :

04097400


NOUATRE

Commune :

NOUATRE (37174)

Localisation :

Pont de la RD 108

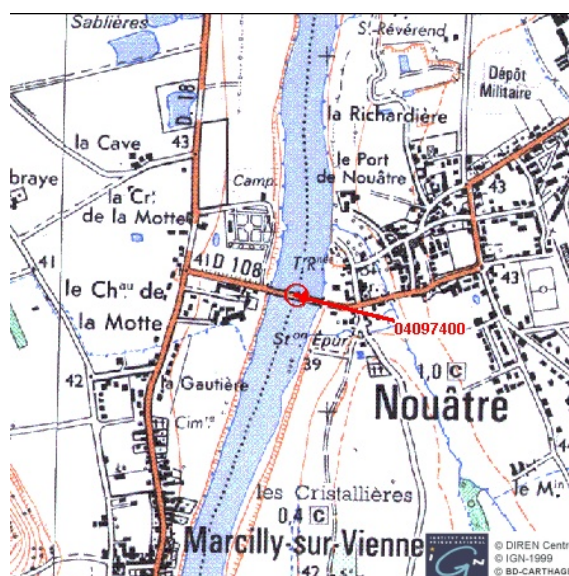

Coordonnées géographiques

	X (m)	Y (m)
Lambert II :	463 916	2 229 323
Lambert 93 :	513 675	6 663 957
Altitude (m) :	33	



Date prél.	Heure	Débit m3/s	T°eau °C	pH	Cond.25° µS/cm	O2 dis. mg/l	Sat. O2 %	MES mg/l	DBO5 mg/l	DCO mg/l	COD mg/l	N Kj mg/l	NH4+ mg/l	NO2- mg/l	NO3- mg/l	PO4--- mg/l	P Total mg/l	Chloro. a µg/l	Phéopig. µg/l
20/11/2008	15:05		11.0	7.5	272	10.4	93	16	4.2		8.1	1.5	0.1	0.04	12	0.14	0.08		
02/10/2008	15:30		15.6	7.4	370	7.0	72	3	4.2		6.9	1.3	0.07	< .02	13	0.11	0.07		
27/08/2008	10:25		20.3	7.7	296	5.6	63	5	2.1		7.3	1.5	< .05	0.04	12	0.19	0.09		
23/07/2008	11:00		21.2	7.9	328	6.2	70	3	2.2		7.0	1.5	0.07	0.03	12	0.07	< .05		
27/05/2008	13:00		15.8	7.4	164	5.1	53	101	4.1		10.0	1.3	0.11	0.05	8	0.14	0.17		
26/03/2008	13:17		9.1	8.1	176	6.9	61	14	2.7		8.9	1.8	0.08	0.04	9	0.11	0.09		
10/12/2007	11:10		9.1	7.5	212	10.4	92	85	3.1		12.0	2	0.18	0.05	9	0.2	0.25	7.1	19
22/10/2007	11:50		11.1	7.7	294	7.1	65	< 2	4.4			2.2	0.06	0.03	11	< .15	< .15	1.1	3.3
24/09/2007	11:15		17.0	7.6	340	8.3	86	27	1.8	16		< 1	0.09	< .02	12	< .15	< .15	1.2	3.1
20/08/2007	11:05		19.1	7.9	331	8.6	94	4	1.2	27		2	0.2	0.03	12	< .15	< .15	1.1	2.4
23/07/2007	11:05		20.6	7.7	250	8.1	92	12	2.2	21		1.1	0.06	0.03	8	< .15	< .15	< 1	1.7
19/06/2007	11:05		18.8	7.5	206	8.6	93	27	3.9	24		1.4	0.16	0.08	9	0.22	< .15	2	7.4
21/05/2007	11:25		18.2	7.8	260	9.2	98	< 2	2	8.7		< 1	< .05	0.07	11	< .15	< .15	9.1	5
12/02/2007	11:25		8.7	7.6	183	11.6	102	99	2.2	33		1.7	0.14	0.2	16	0.26	0.15	6.1	15
11/12/2006	11:35		8.3	7.8		10.4	88	41	1.9	22		1.7	0.14	0.12	14	0.2	< .15	2.2	6.4
23/10/2006	11:25		16.2	7.9		9.3	97	17	2.5	< 20		< 1	0.07	0.04	13	0.17	< .15	4.1	5.6
18/09/2006	11:45		19.8	7.2		8.8	98	7	2.3	< 20		< 1	< .05	0.04	9	0.18	< .15	5.1	4.9
21/08/2006	11:20		20.3	7.5				< 2	1.3	< 20		< 1	0.24	0.04	9	< .15	< .15	4	4.2
17/07/2006	11:20		26.8	8.0				5	1.4	< 20		1.4	0.14	0.05	11	< .15	< .15	17	4.1
19/06/2006	11:15		24.7	7.7				4	1.1	< 20		1.1	0.12	0.06	13	< .15	< .15	15	11
29/05/2006	11:15		18.0	7.3		9.6	101	9	1.7	< 20		1.4	0.15	0.06	12	< .15	< .15	4.7	4.1
13/02/2006	11:25		5.5	7.6		12.6	99	6	3.8	< 20		1.7	0.07	0.08	15	< .15	< .15	11	3.7

Date prél.	Heure	Débit m3/s	T°eau °C	pH	Cond.25° µS/cm	O2 dis. mg/l	Sat. O2 %	MES mg/l	DBO5 mg/l	DCO mg/l	COD mg/l	N Kj mg/l	NH4+ mg/l	NO2- mg/l	NO3- mg/l	PO4--- mg/l	P Total mg/l	Chloro. a µg/l	Phéopig. µg/l
12/12/2005	11:30		5.6	7.4		11.5	91	8	2.8	23		< 1	0.12	0.08	15	< .15	< .15	2.1	6.6
24/10/2005	11:05		15.8	7.4		8.4	86	11	2.9	< 20		1.4	0.09	0.05	9	0.17	< .15	2.9	6.4
19/09/2005	11:35		17.0	7.2				4	2	< 20		1.7	< .05	0.05	10	0.19	< .15	1.8	2.6
22/08/2005	11:30		21.0	7.4		8.5	95	3	1.8	< 20		1.1	0.1	0.04	9	< .15	< .15	1.5	2.5
25/07/2005	11:05		22.1	7.3		7.3	84	31	2.2	< 20		< 1	0.09	0.04	8	0.15	< .15	< 1	5.7
20/06/2005	11:25		25.2	7.2		6.4	78	3	1.9	< 20		< 1	0.31	0.08	11	0.18	< .15	< 1	3.7
23/05/2005	11:25		17.6	7.3		9.2	96	17	< 1	< 20		< 1	0.08	0.05	11	< .15	< .15	1.2	4
14/02/2005	11:35		6.8	7.2		11.5	96	25	2.6	< 20		1.7	0.13	0.09	10	0.15	< .15	4.3	7.5
13/12/2004	11:05		5.2	7.5		11.9	92	5	2.1	< 20		< 1	0.08	0.05	14	0.18	< .15	2	< 1
18/10/2004	10:40		13.3	7.3		9.4	90	6	2.1	20		1.1	0.08	0.03	11	0.16	< .15	4.3	3.9
20/09/2004	10:50		16.3	7.3		8.9	91	< 2	2.2	< 20		< 1	< .05	0.04	13	0.2	< .15	1.2	1.9
23/08/2004	10:10		20.4	6.9		8.4	94	13	2.4	44		1.1	0.15	0.06	11	0.24	0.16	2	6.3
19/07/2004	11:15		23.2	7.5		9.2	104	< 2	1.7	< 20		< 1	0.06	0.06	13	< .15	< .15	2.1	< 1
28/06/2004	10:45		21.9	7.4		8.1	91	< 2	< 1	< 20		< 1	0.12	0.05	14	0.17	< .15	1.5	4.6
24/05/2004	11:00		18.0	7.3		8.9	94	4	2	< 20		< 1	0.08	0.05	12	< .15	< .15	5.3	5.1
09/02/2004	10:35		7.7	7.3		11.3	93	7	3.1	< 20		< 1	< .05	0.06	18	< .15	< .15	1.6	2
15/12/2003	10:15		8.1	7.3		11.2	94	9	2	< 20		< 1	0.08	0.05	17	< .15	< .15	1.3	3.8
20/10/2003	10:35		13.1	7.5		9.2	89	7	1.3	20		< 1	0.07	0.06	15	0.19	< .15	3.7	5.2
22/09/2003	10:00		20.0	7.9		6.9	76	5	2.5	< 20		1.1	< .05	0.05	13	0.21	< .15	2.5	3.6
18/08/2003	10:10		24.5	7.5				3	1.8	< 20		< 1	0.12	0.09	11	< .15	< .15	3.6	6.9
21/07/2003	10:30		24.2	7.5		8.7	104	< 2	2.4	< 20		< 1	< .05	0.07	15	0.21	< .15	2.1	4.6
16/06/2003	10:50		25.4	7.2		7.1	87	9	2	< 20		< 1	< .05	0.05	16	0.17	< .15	3.2	< 1
26/05/2003	10:40		17.1	7.4		10.0	103	13	3.5	< 20		< 1	< .05	0.09	12	< .15	< .15	11	5.8
10/02/2003	11:15		5.9	7.2				26	3.5	< 20		< 1	0.06	0.05	13	< .15	< .15	< 1	6.8

Qualité des eaux


Station : NOUATRE


Code : 04097400


Cours d'eau : VIENNE


Date prél.	Heure	Débit m3/s	T°eau °C	pH	Cond.25° µS/cm	O2 dis. mg/l	Sat. O2 %	MES mg/l	DBO5 mg/l	DCO mg/l	COD mg/l	N Kj mg/l	NH4+ mg/l	NO2- mg/l	NO3- mg/l	PO4--- mg/l	P Total mg/l	Chloro. a µg/l	Phéopig. µg/l
09/12/2002	11:50		7,2	7,4	195			20	2,5	20		1,4	0,07	0,05	14	0,17	< .15	2,3	5,1
21/10/2002	11:15		13,8	7,4	288			5	2,4	< 20		1,4	< .05	0,04	11	< .15	< .15	2,1	5,3
23/09/2002	11:15		18,1	7,2	276	8,6	89	6	1,6	< 20		1,4	0,07	0,04	10	0,18	< .15	< 1	7,3
19/08/2002	11:05		22,8	7,5	308	7,6	87	3	1,7	< 20		1,7	0,11	0,08	10	0,16	< .15	3,5	4,2
22/07/2002	10:40		22,7	7,2	306	7,4	86	8	4,5	42		1,7	< .05	0,05	13	0,23	< .15	1,8	3,4
24/06/2002	11:00		22,8	7,4	302	7,2	83	7	2,8	< 20		1,4	0,08	0,07	14	0,21	< .15	1,1	2,7
27/05/2002	11:15		16,9	7,1	239	9,3	97	15	4,2	< 20		1,4	< .05	0,1	11	0,19	< .15	4,3	6,2
11/02/2002	11:00		9,8	7,5	230	11,2	99	10	2	< 20		1,1	0,11	0,1	14	< .15	< .15	2,7	4,2
17/12/2001	12:00		1,6	8,2	244			5	2,3	< 20		1,4	< .05	0,08	16	0,17	< .15		
22/10/2001	10:45		16,0	8,0	306	9,0	92	44	3	21		1,4	0,07	0,05	12	< .15	< .15	12,9	18,9
24/09/2001	11:00		15,6	7,5	230	9,4	95	7	2	< 20		< 1	< .05	0,05	11	< .15	< .15	3,6	5,2
20/08/2001	11:05		21,5	7,7	325	8,4	96	7	4	28		1,7	< .05	0,04	13	< .15	< .15	12,5	8,9
23/07/2001	10:55		21,3	7,3	209	8,5	96	10	2	< 20		< 1	0,08	0,04	14	< .15	< .15	5,7	3,2
25/06/2001	10:40		23,7	7,8	280			11	4	20		1,4	0,05	0,05	14	< .15	< .15	17,9	7,8
28/05/2001	11:00		20,1	7,4	228	9,7	106	9	5	29		1,1	0,06	0,06	14	< .15	< .15	11,7	5,8
12/02/2001	12:00		9,4	7,4	220	11,2	99	17	3	< 20		0,8	0,09	0,06	11	0,15	< .15	2,1	3,5
11/12/2000	11:45	454,000	10,6	7,7		10,9		21	2	20		1,1	0,08	0,07	12	0,09	< .2		
16/10/2000	11:20	60,100	13,2	8,2		9,6	92	14	2	< 20		0,6	0,08	0,05	9	0,27	< .2	6,1	7,5
18/09/2000	10:45	46,200	18,4	7,7		8,9	96	11	3	< 20		0,8	0,04	0,05	13	0,15	< .2	10	8
21/08/2000	10:55	46,800	21,2	7,9		7,9	89	9	4	23		2	0,06	0,07	16	0,28	0,2	7	6
17/07/2000	11:15	135,000	18,6	7,4		8,9	93	11	1	30		0,6	0,06	0,05	16	0,18	< .2	5,7	3,6
19/06/2000	11:15	81,100	24,2	7,9		9,1	104	14	3	27		1,1	0,11	0,05	12	0,09	< .2	32	14
22/05/2000	11:25	207,000	16,6	7,3		9,4	97	18	2	< 20		2	0,02	0,07	11	< .05	< .2	6,4	4,1
16/02/2000	11:15	445,000	8,5	7,6		11,8	98	19	4	30		1,4	0,09	0,07	13	0,21	< .2	6,4	1,8


Seq-Eau 32 bits version 1.13.08 - 03/06/1999
Date d'édition: 16/07/2004

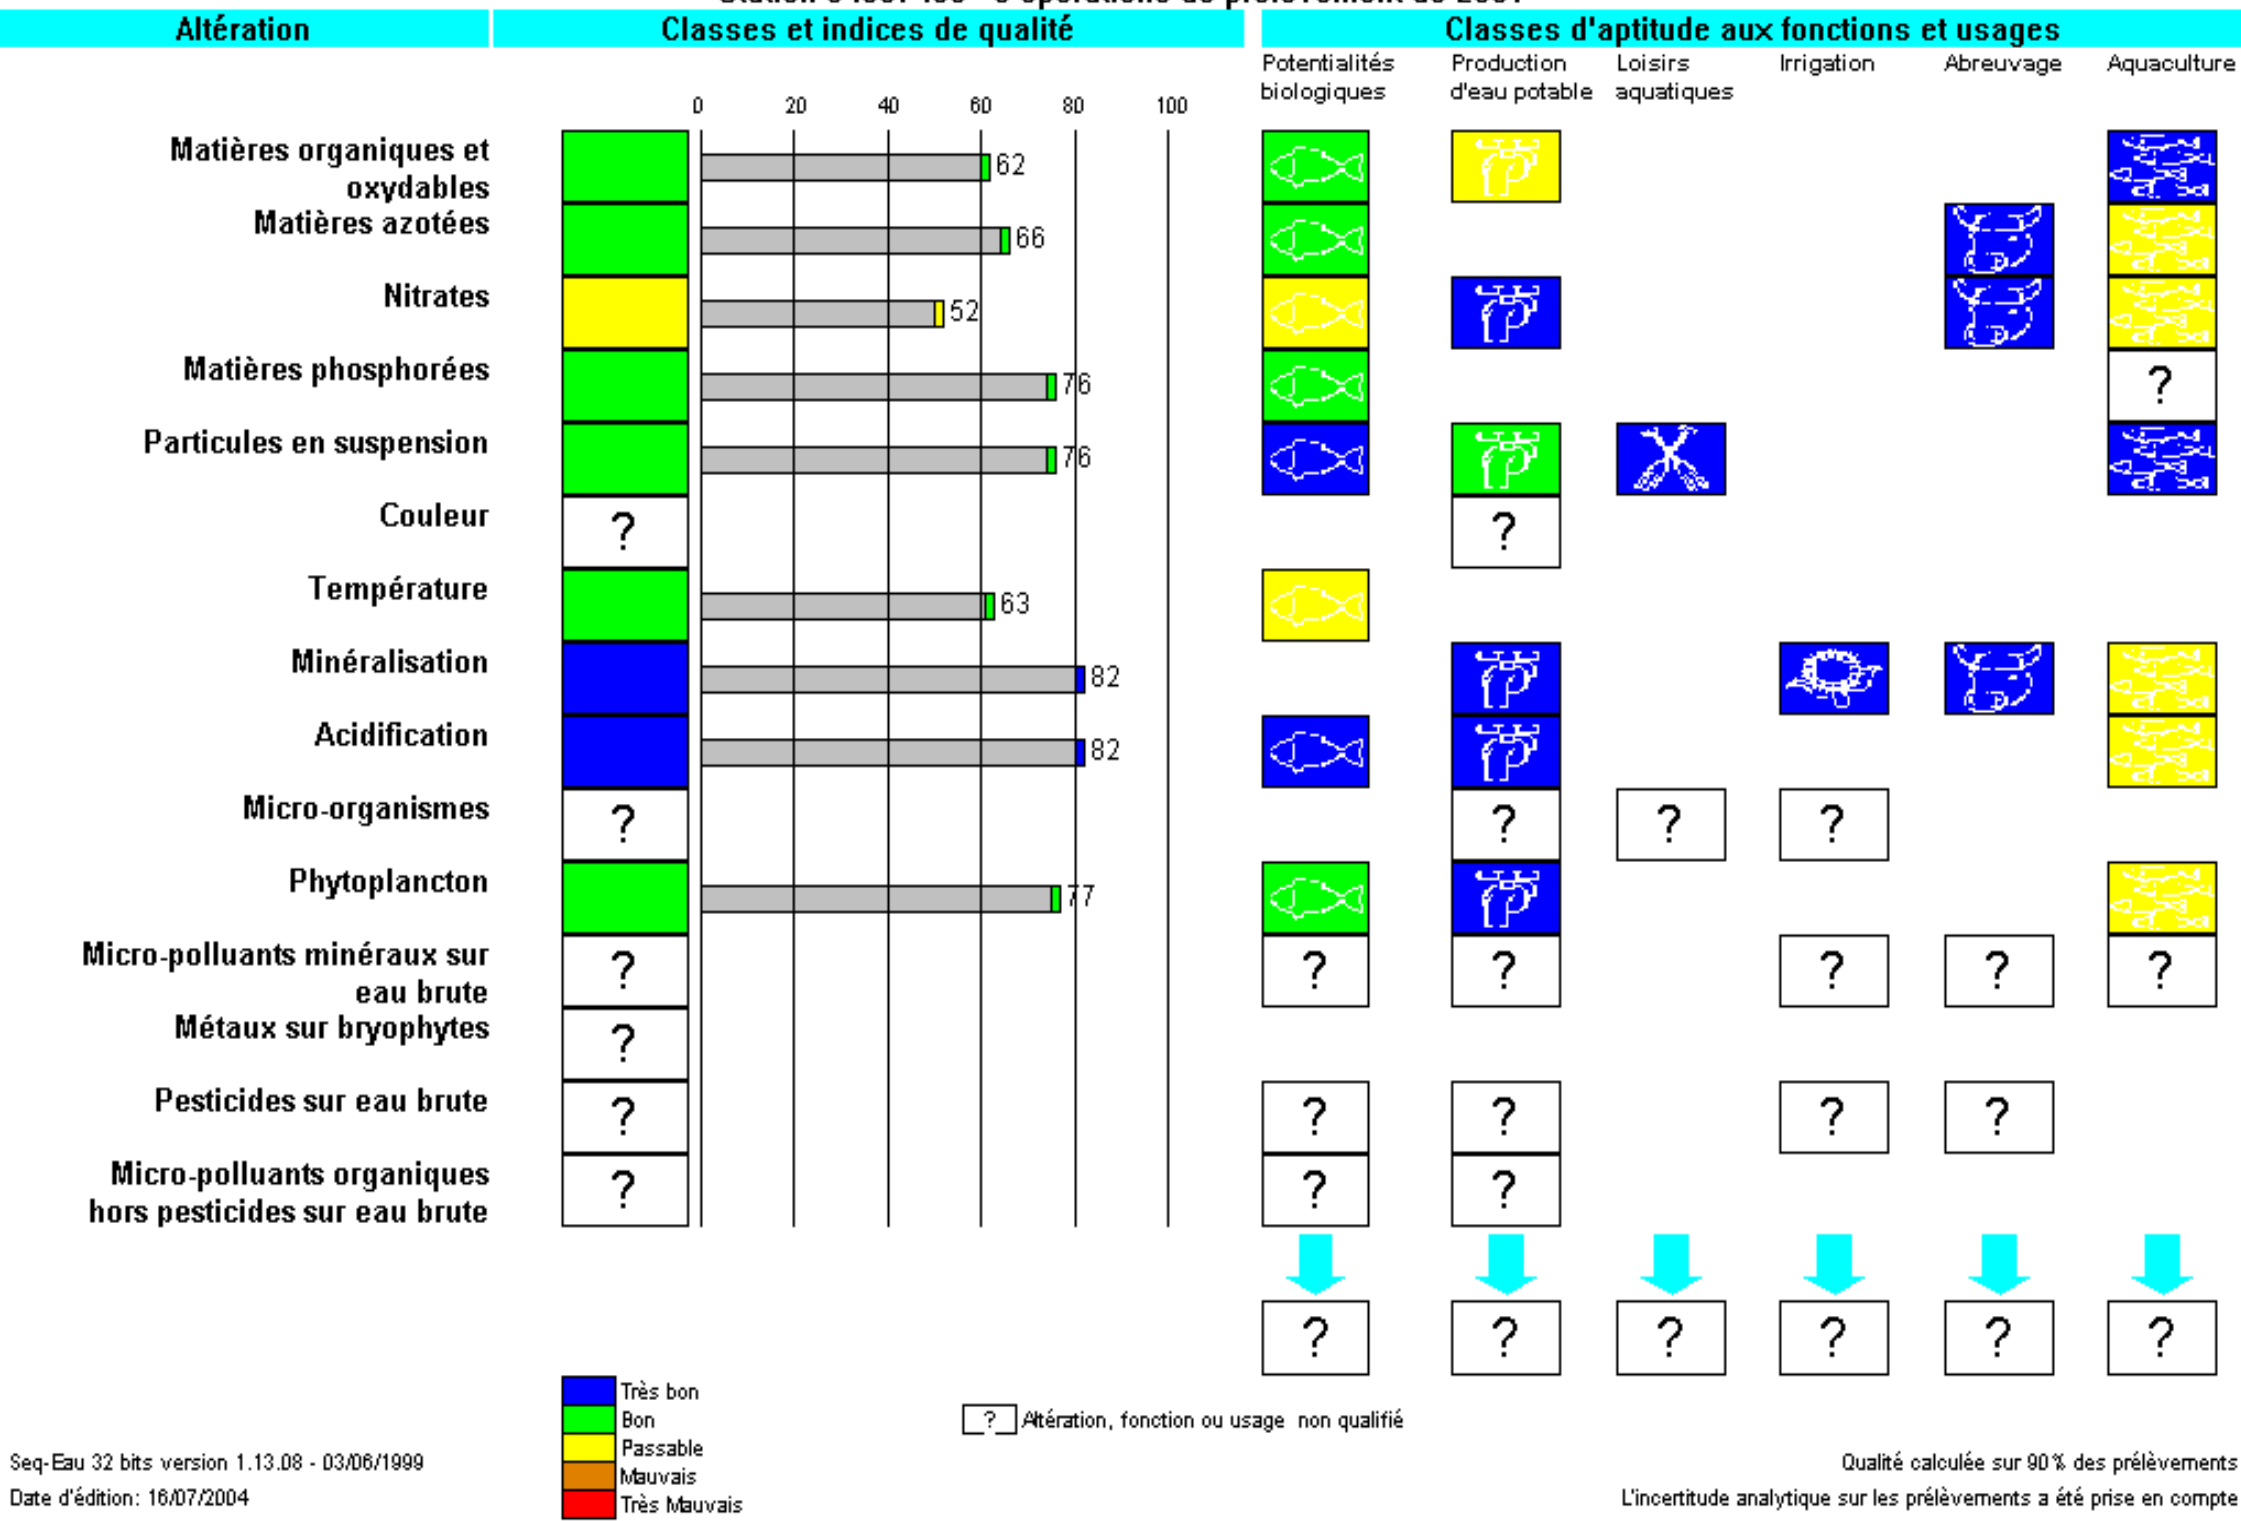


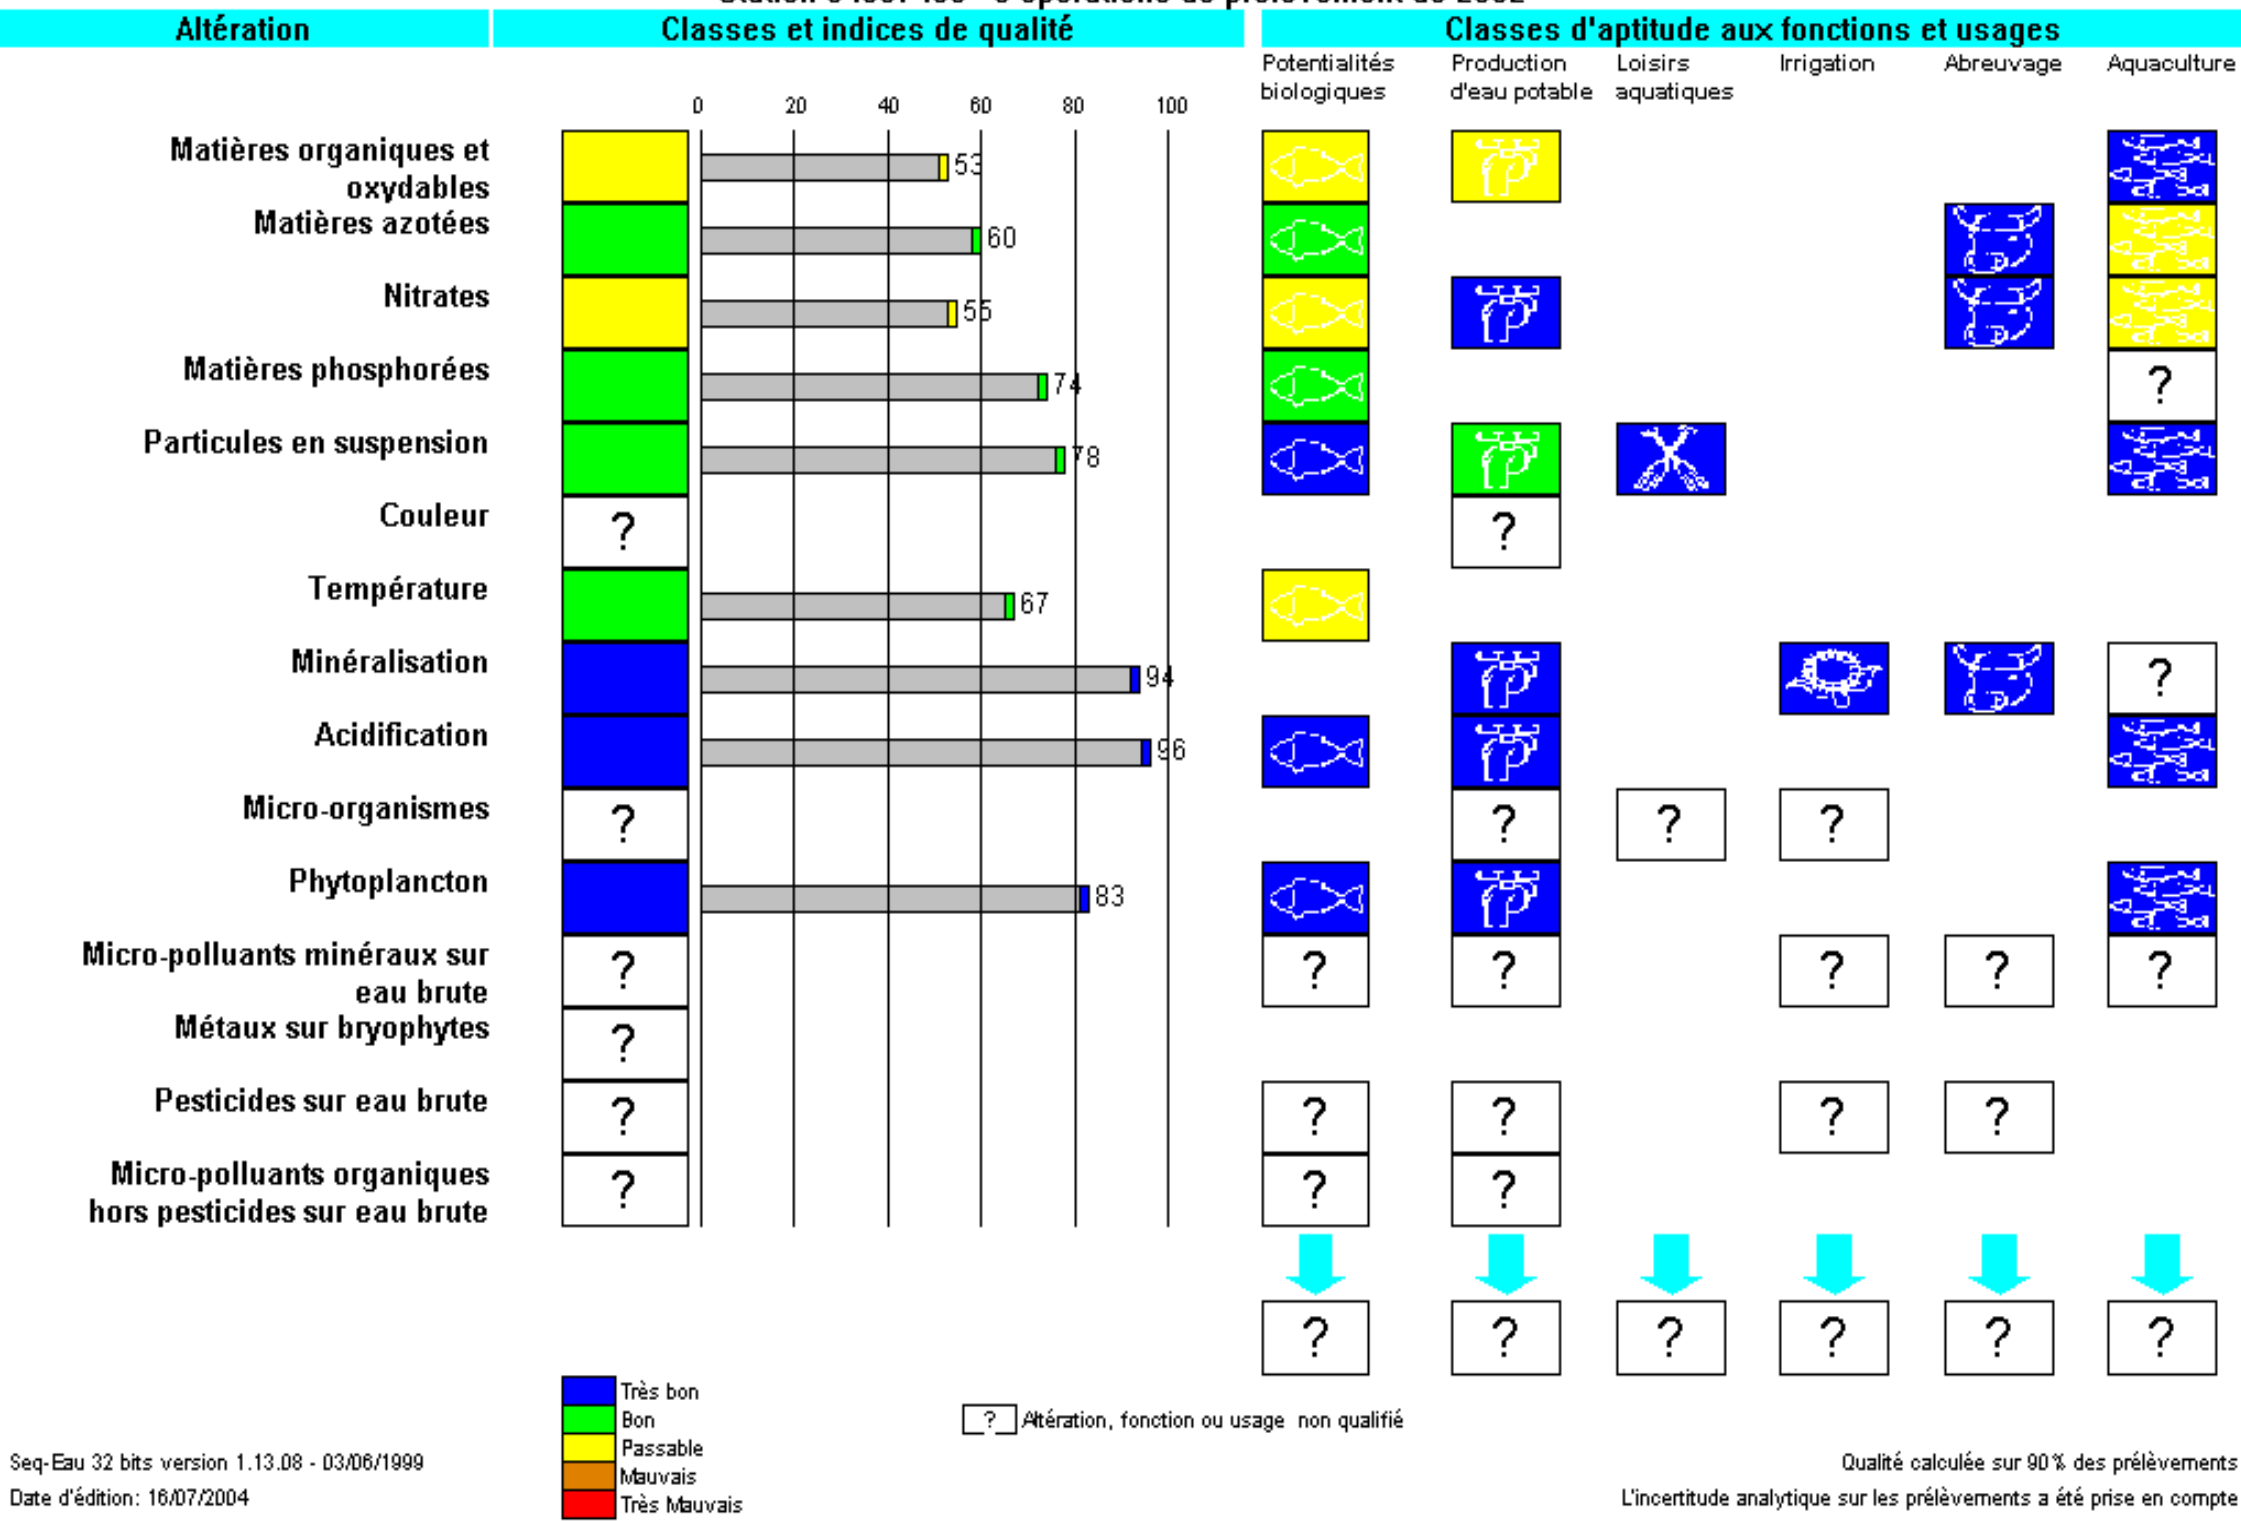


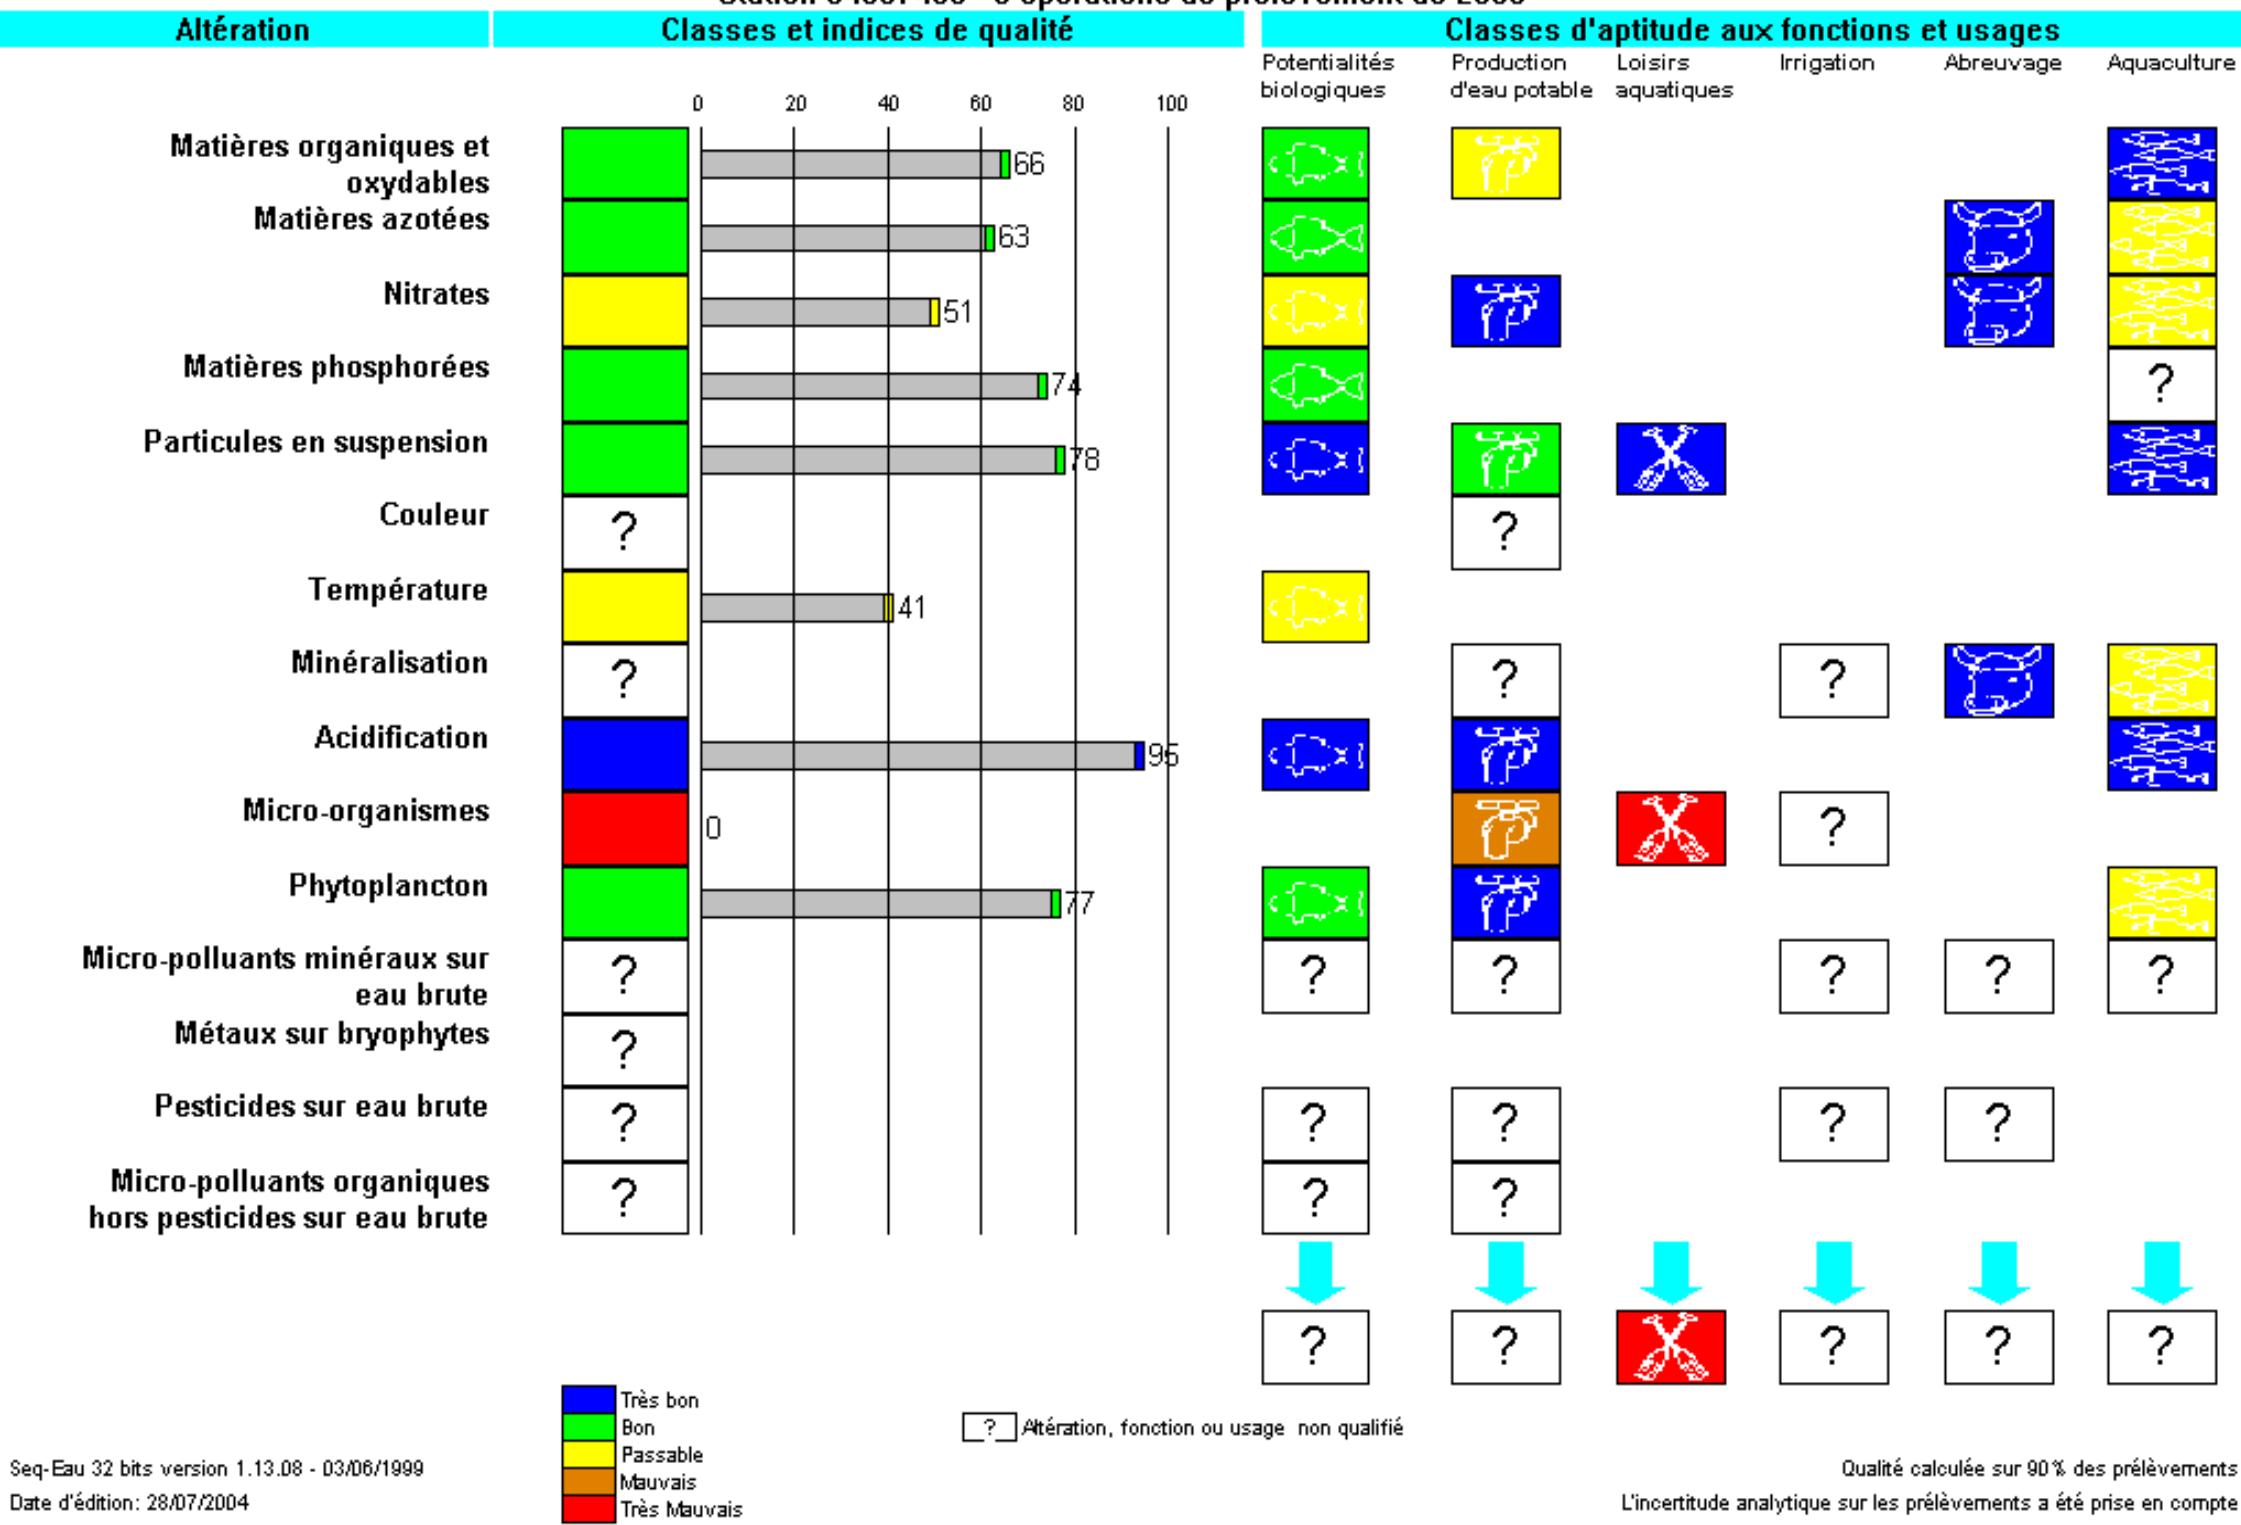


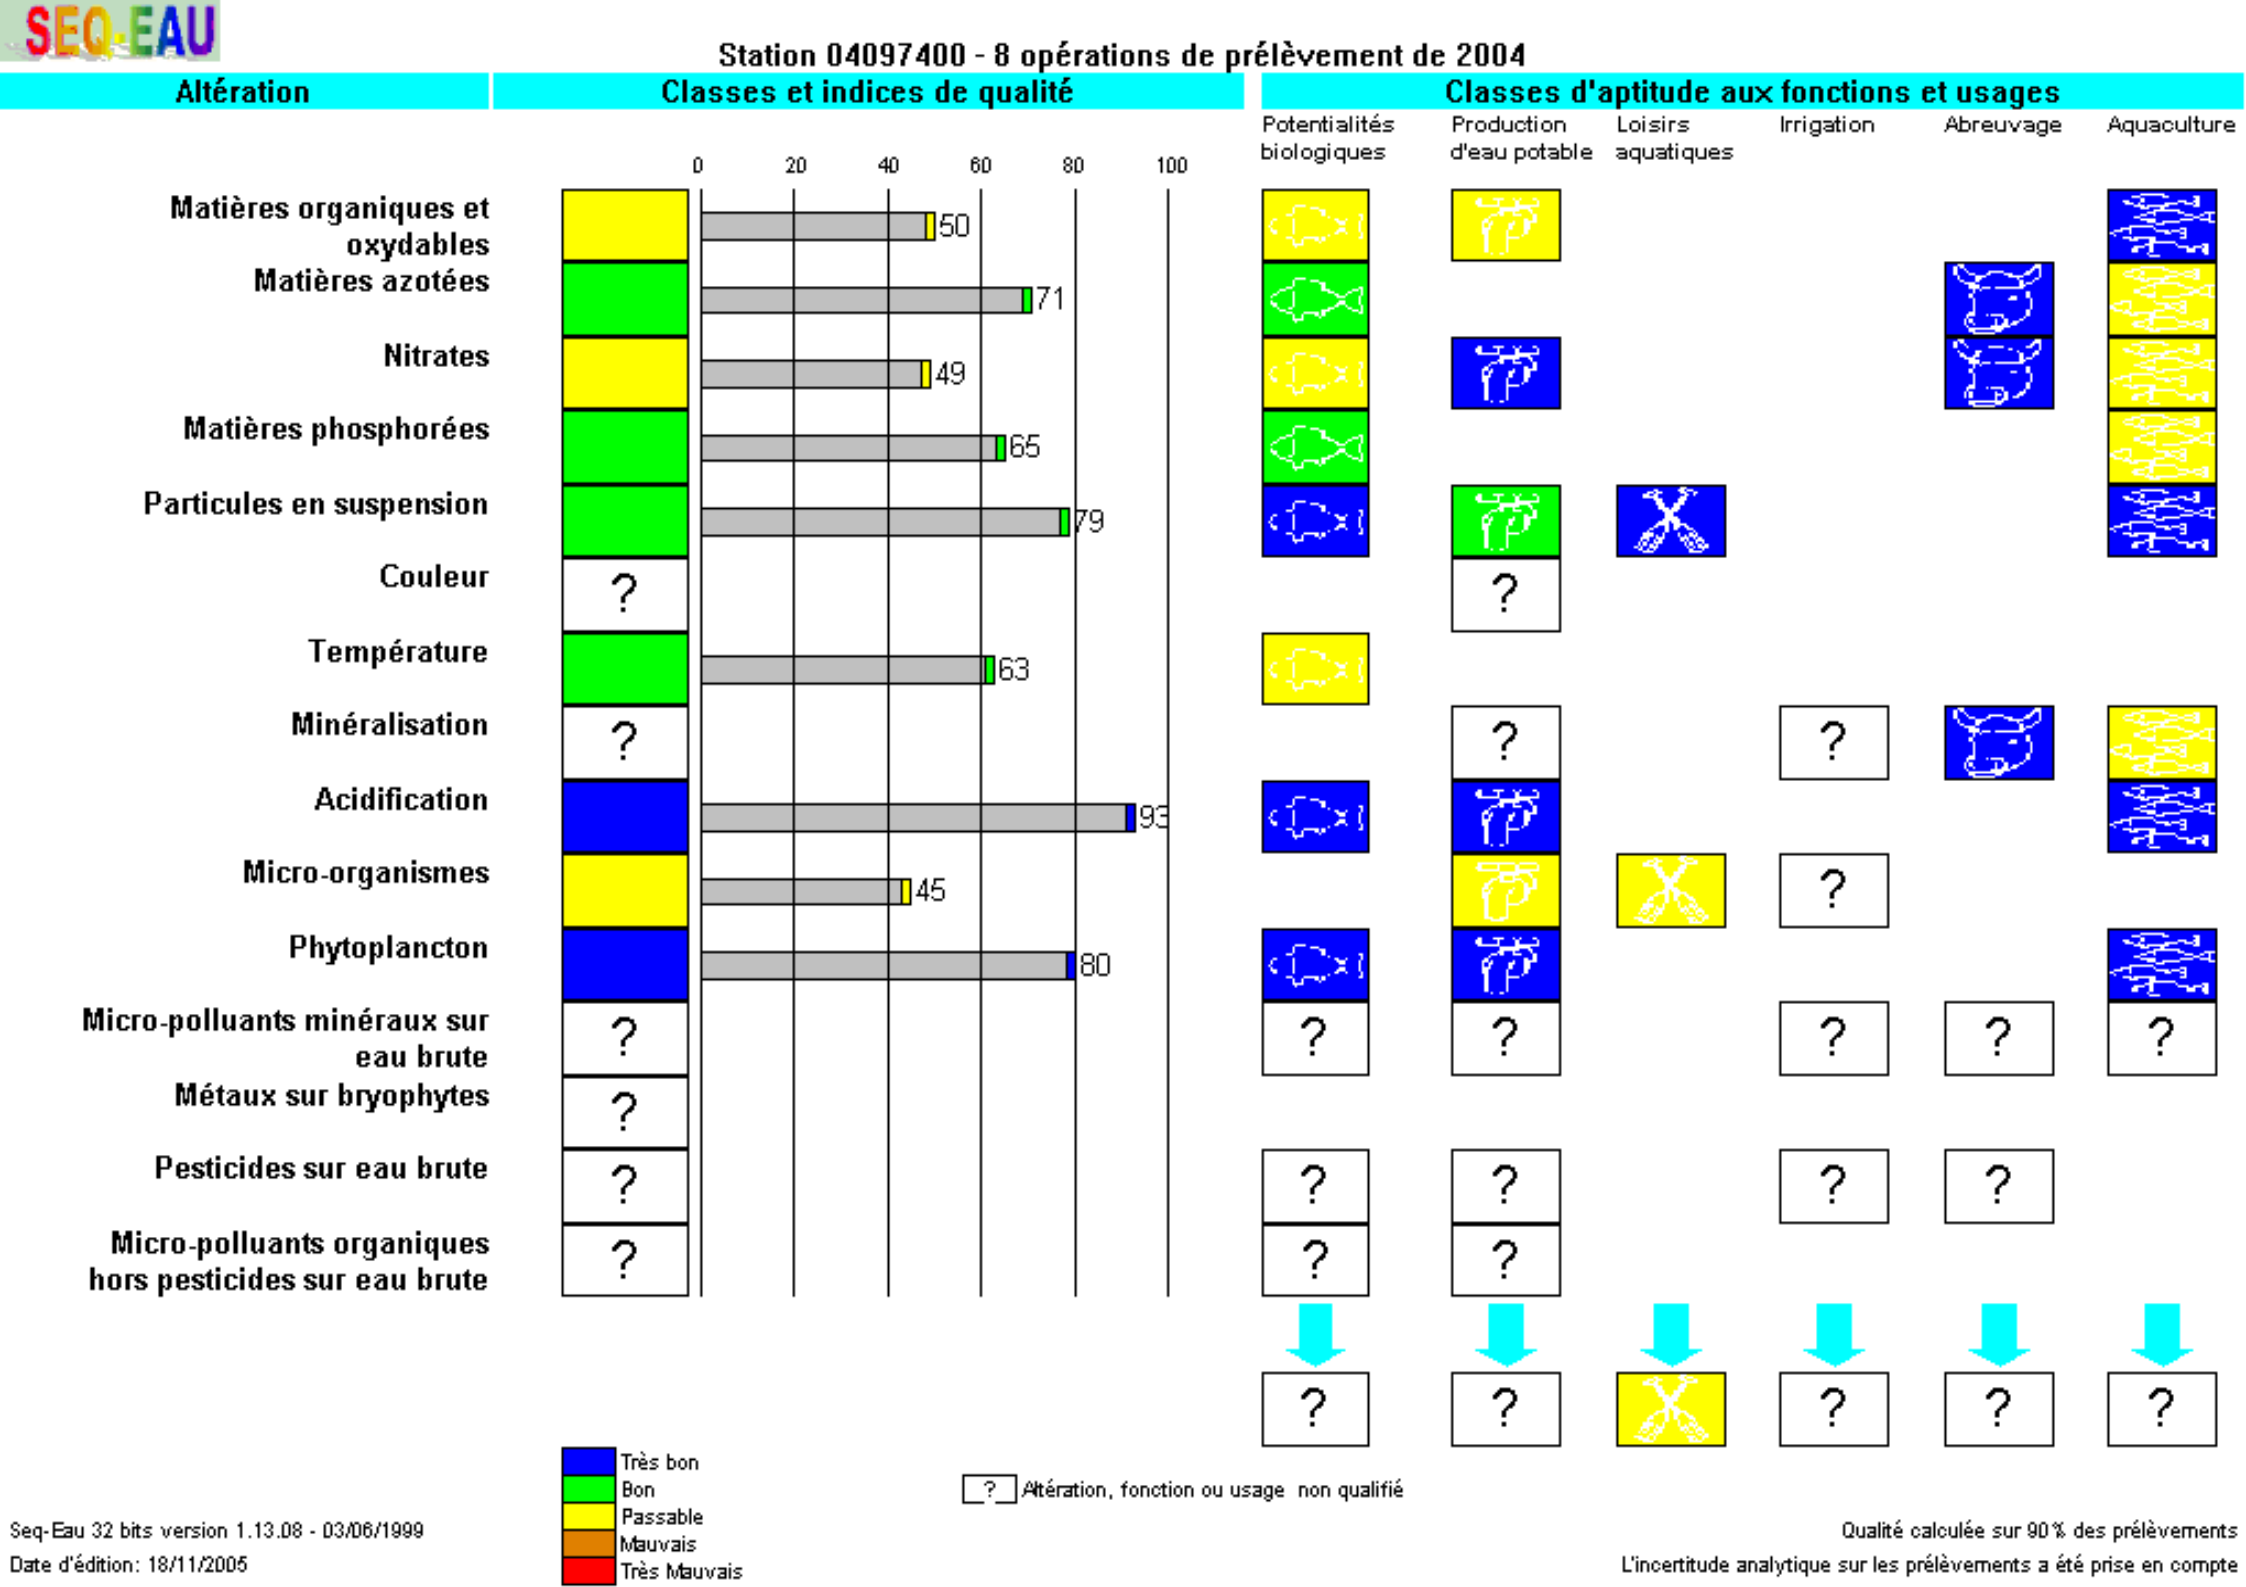

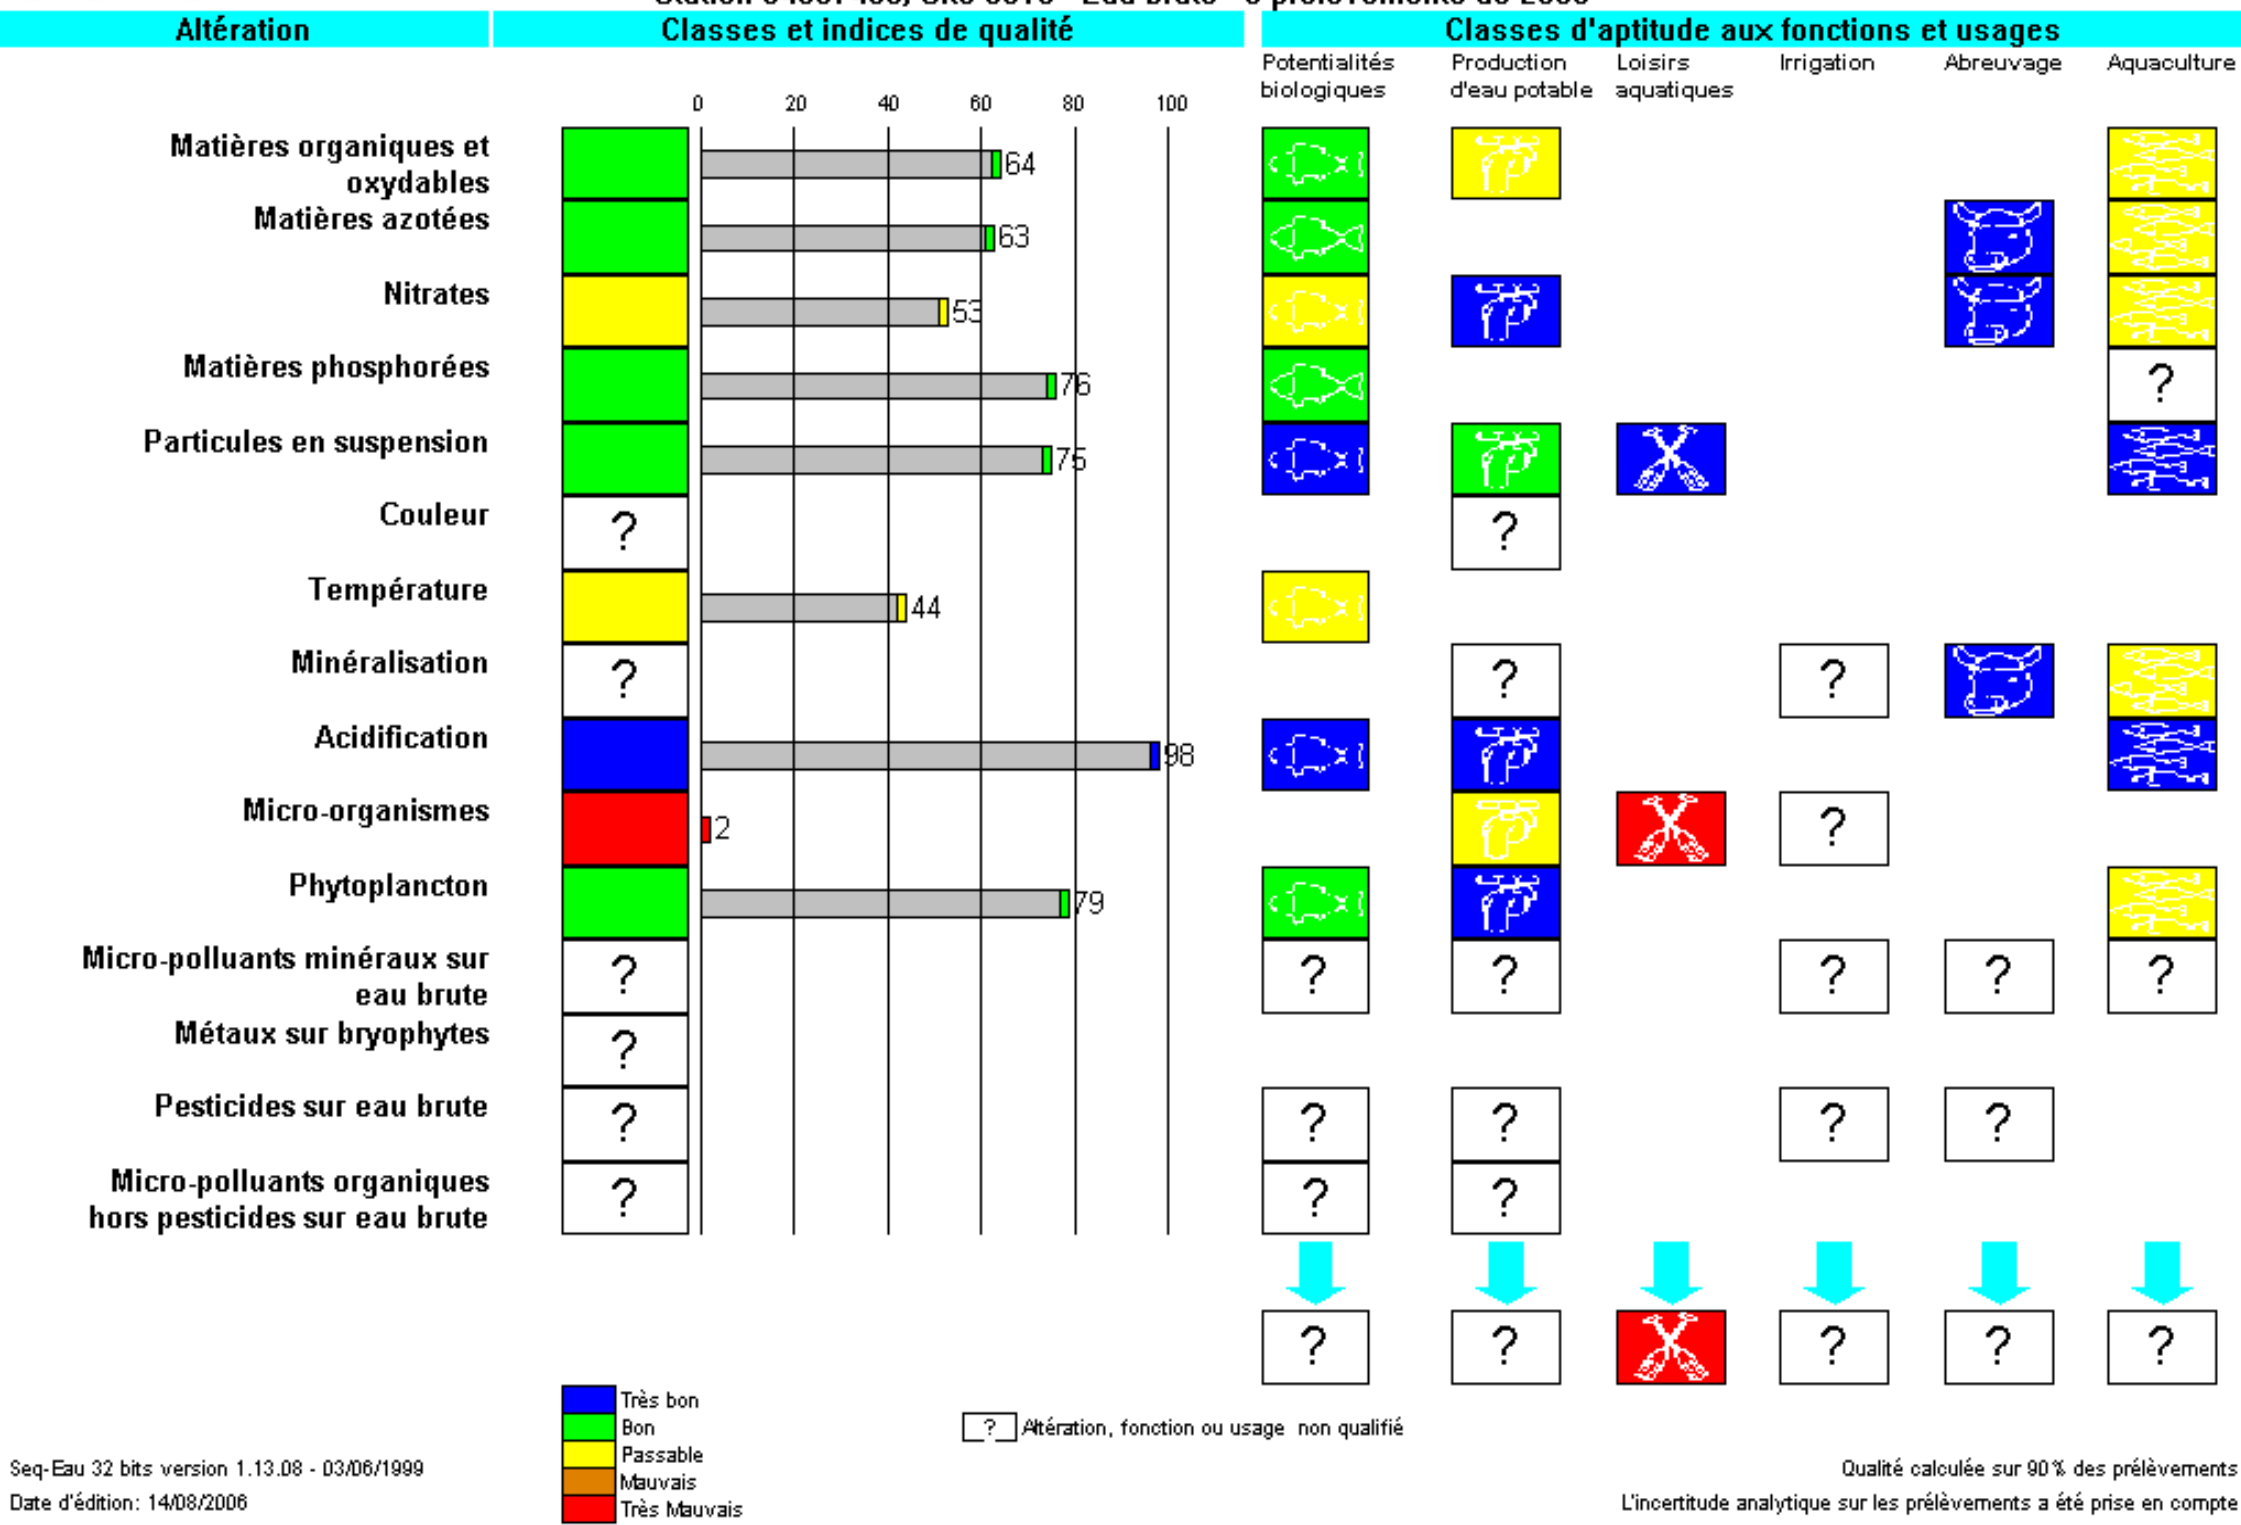

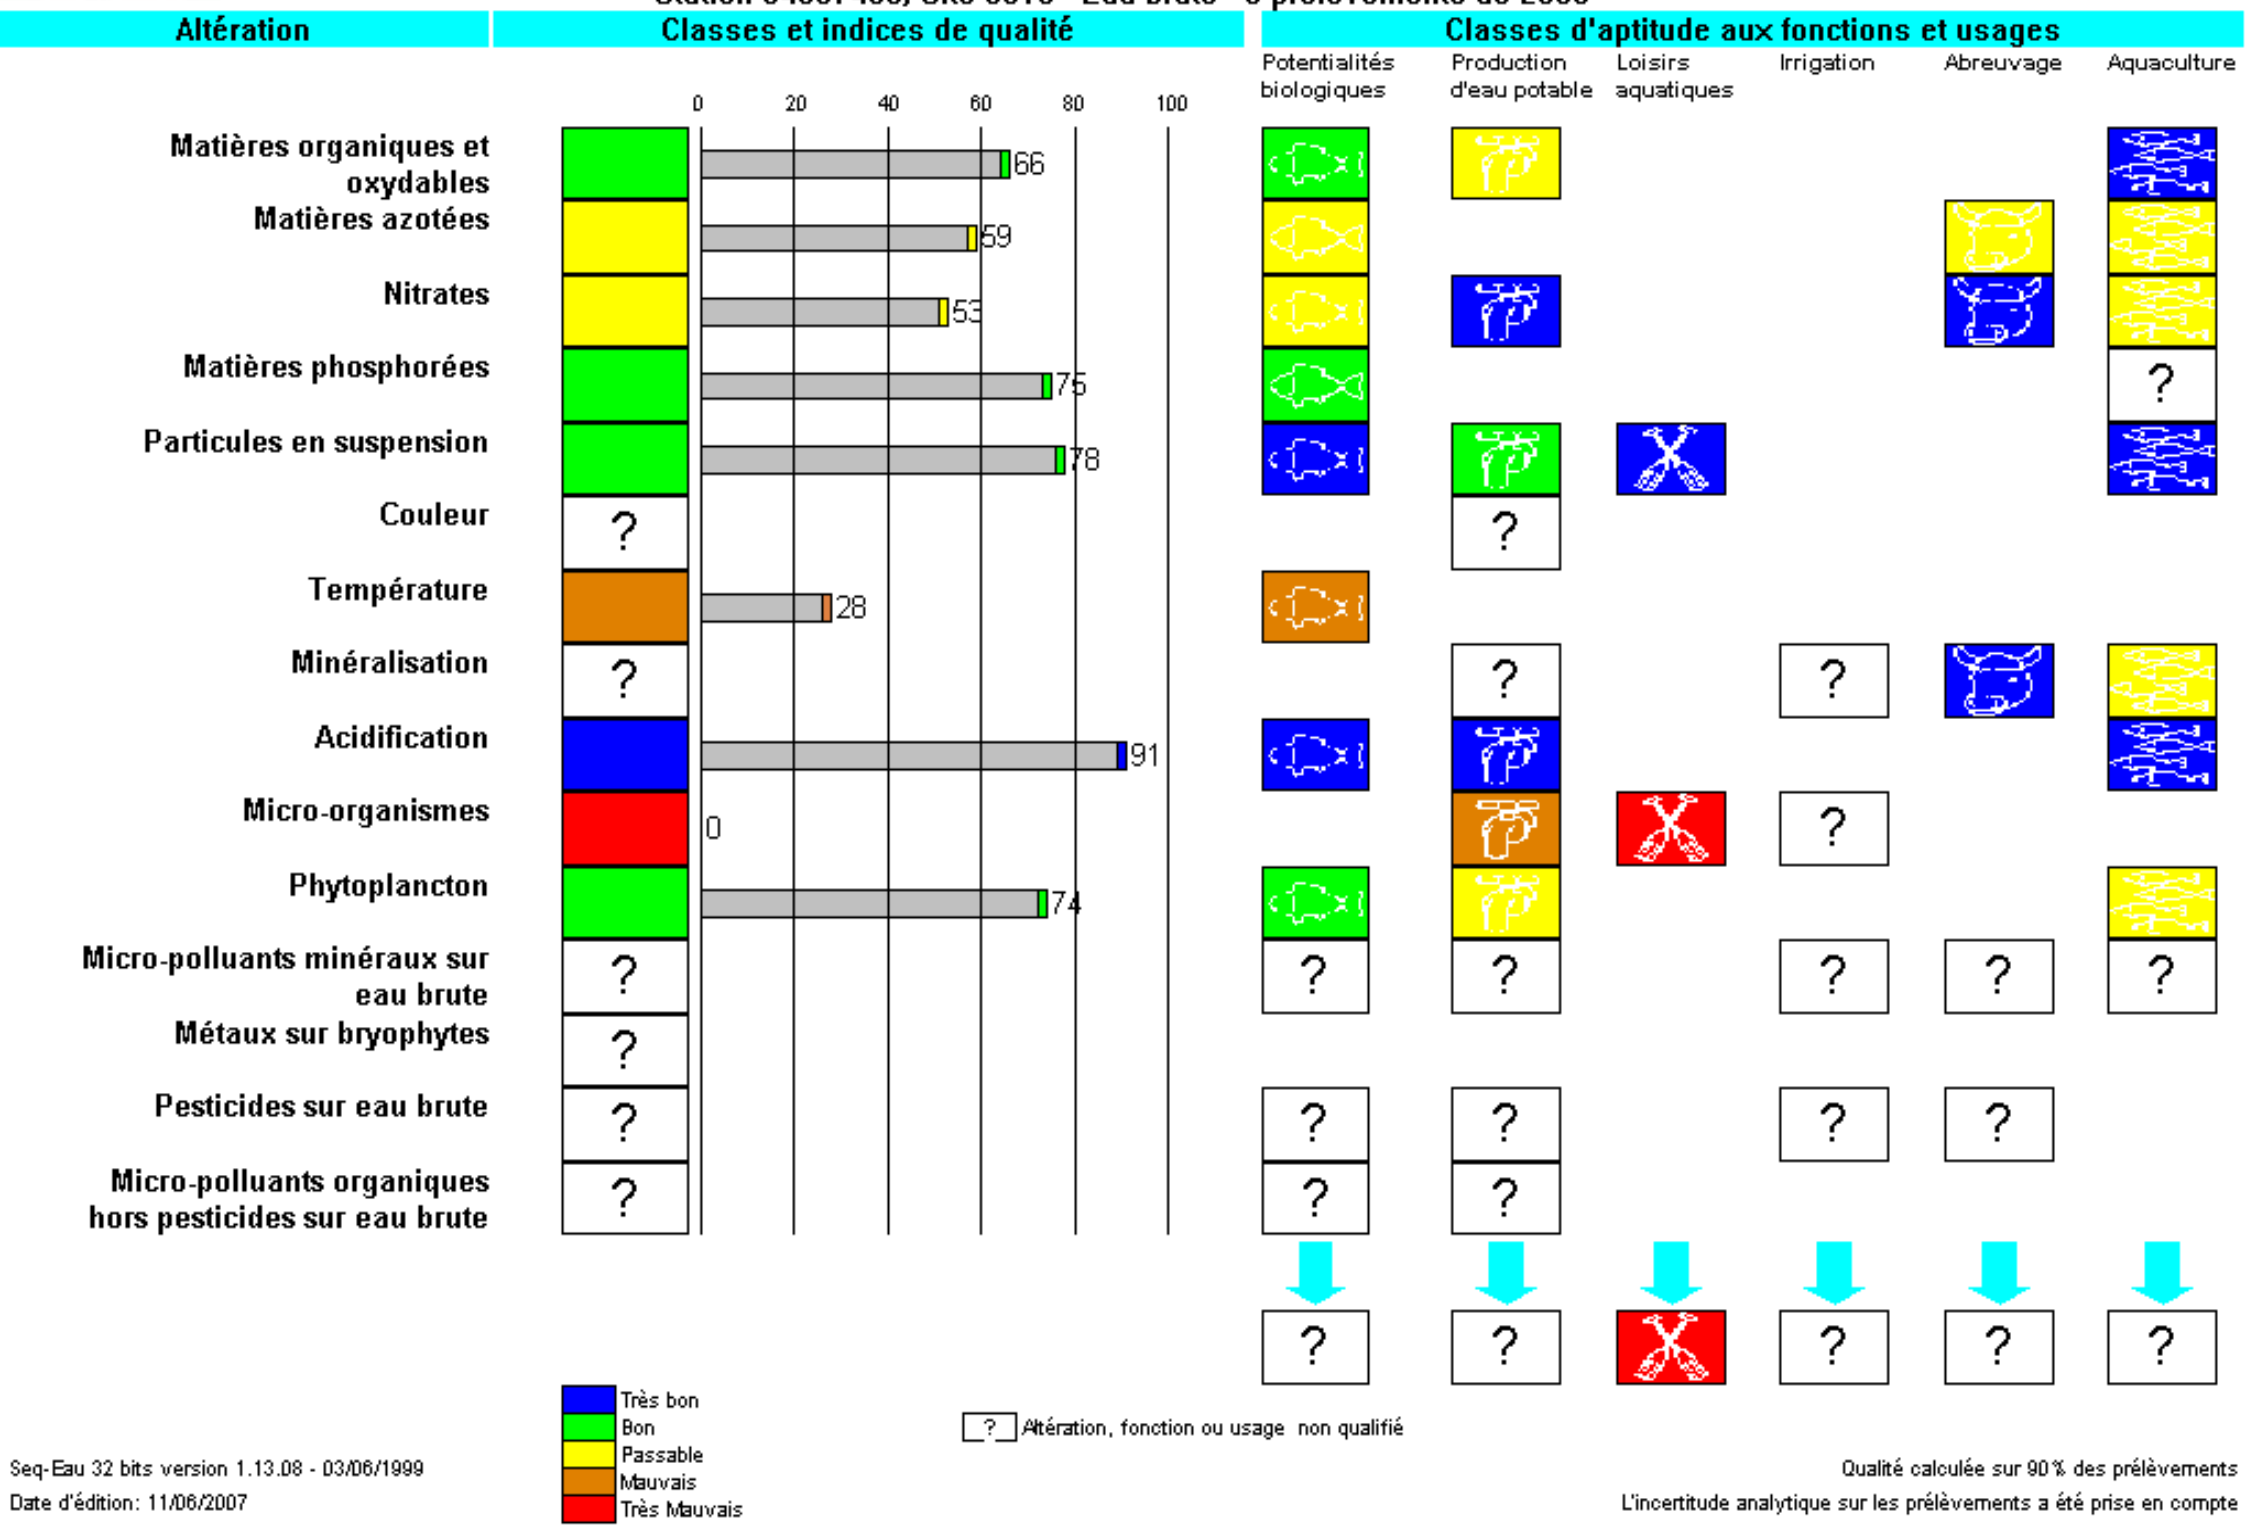

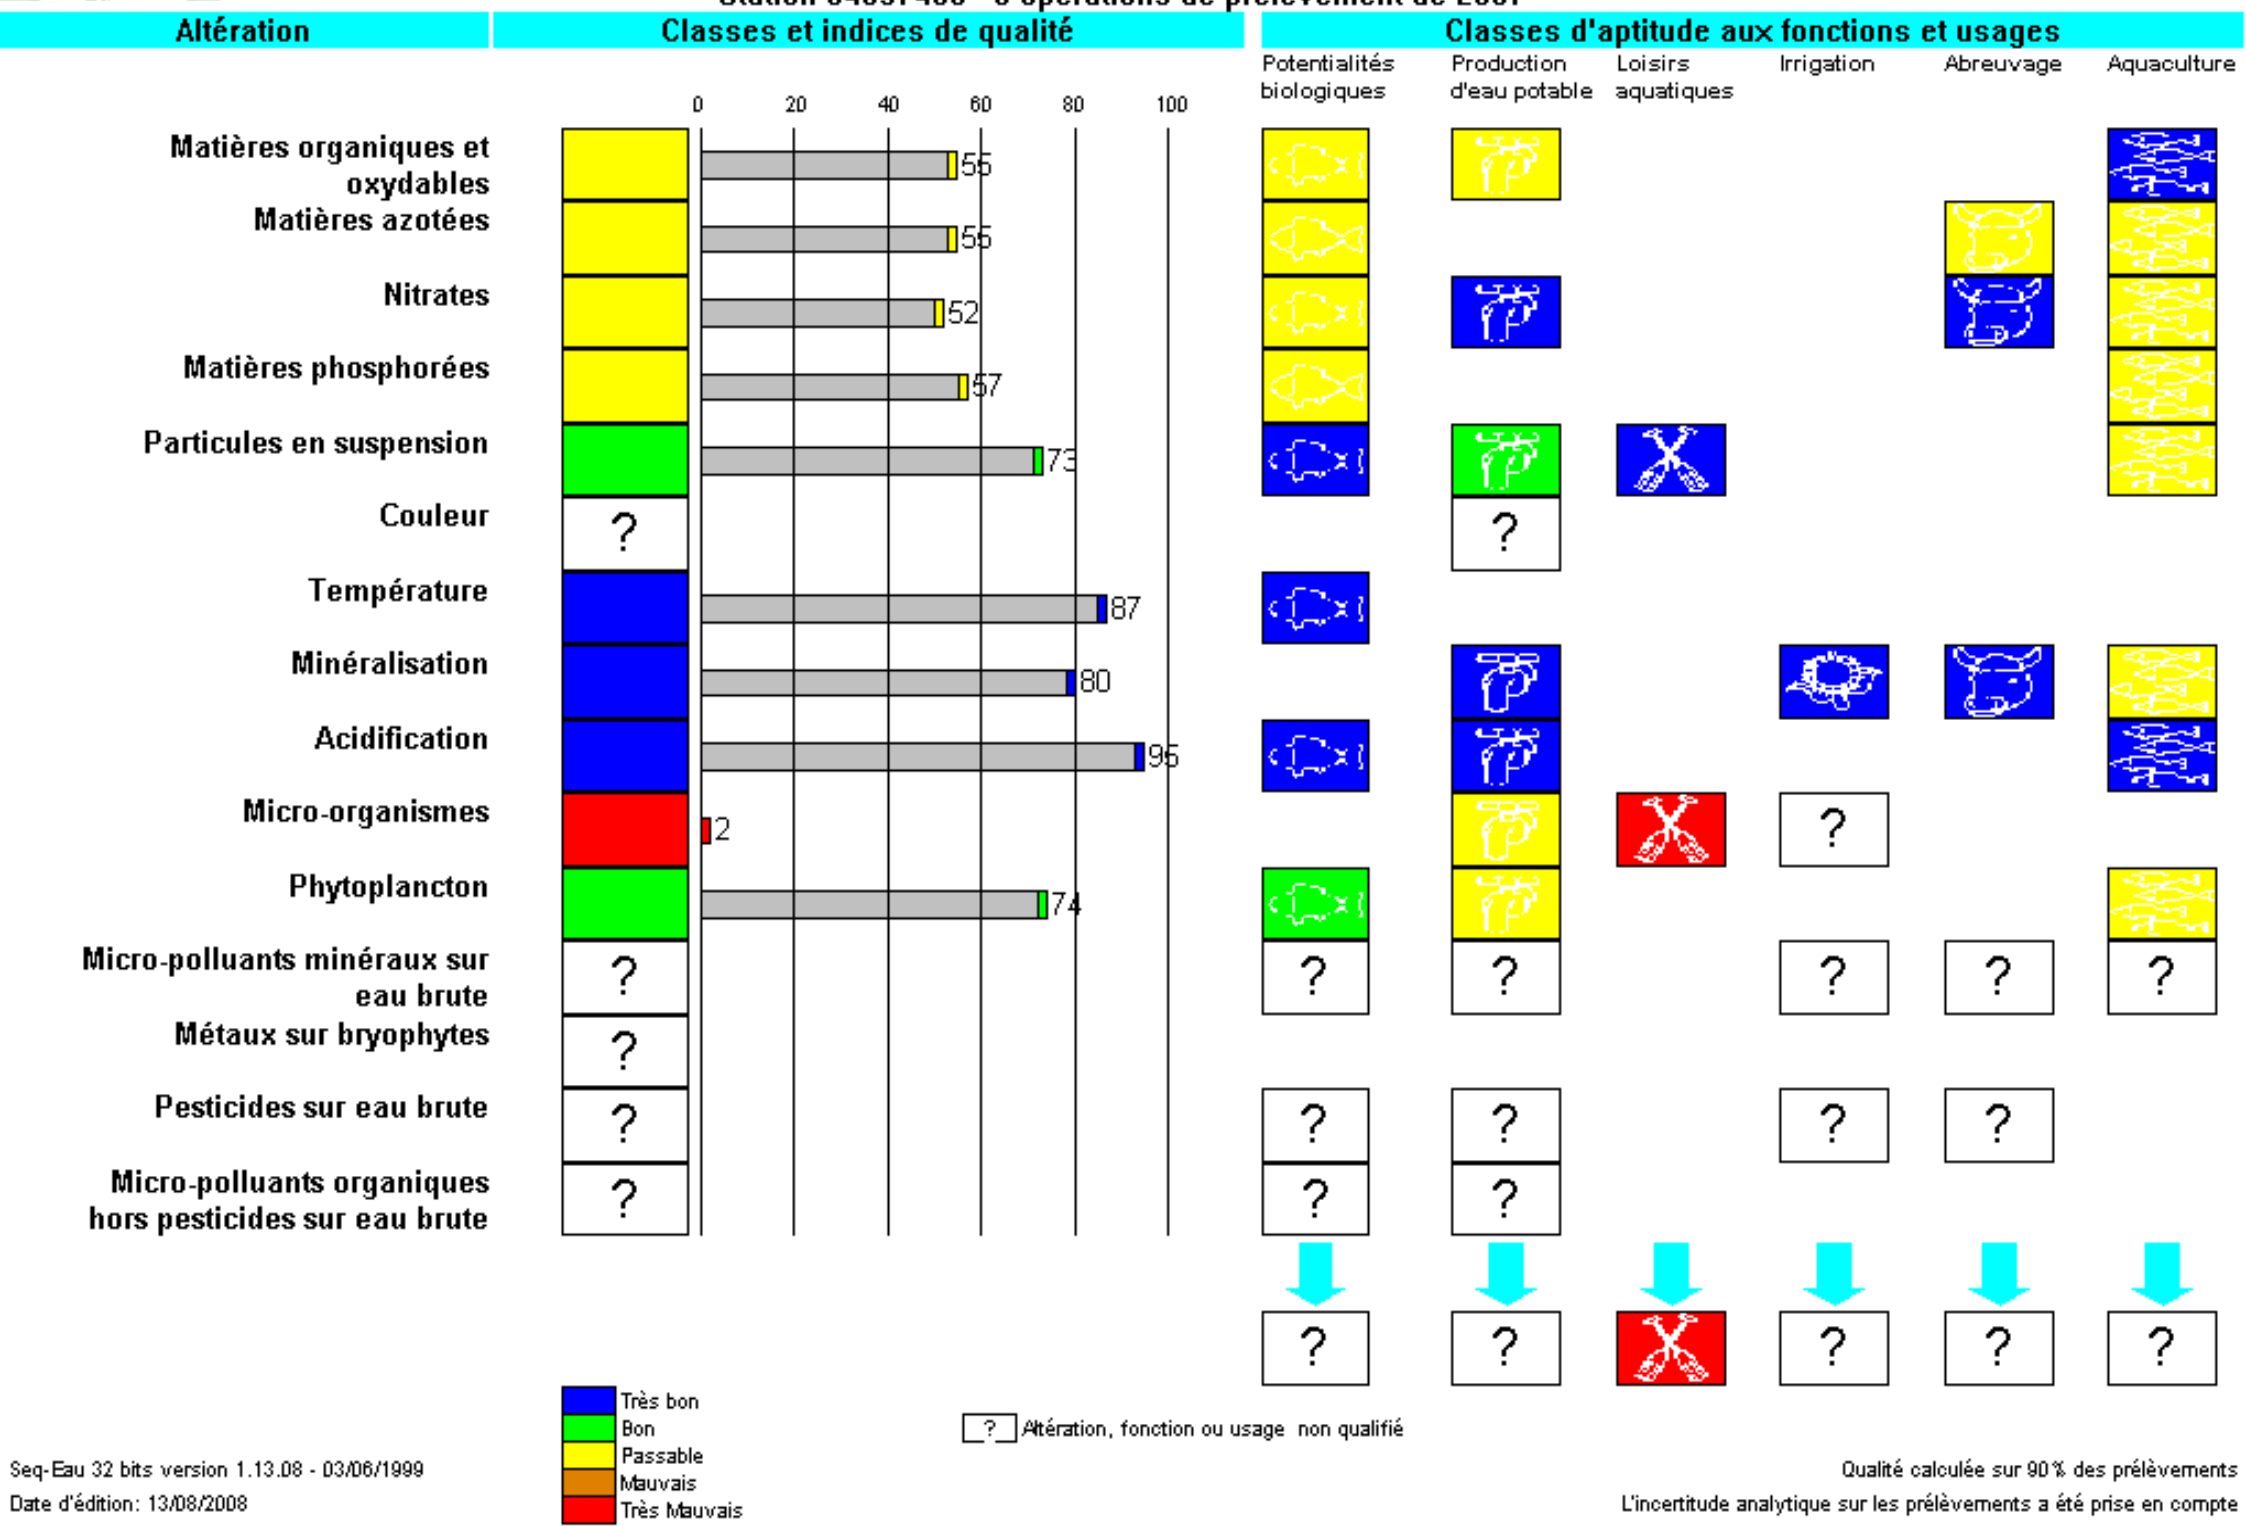

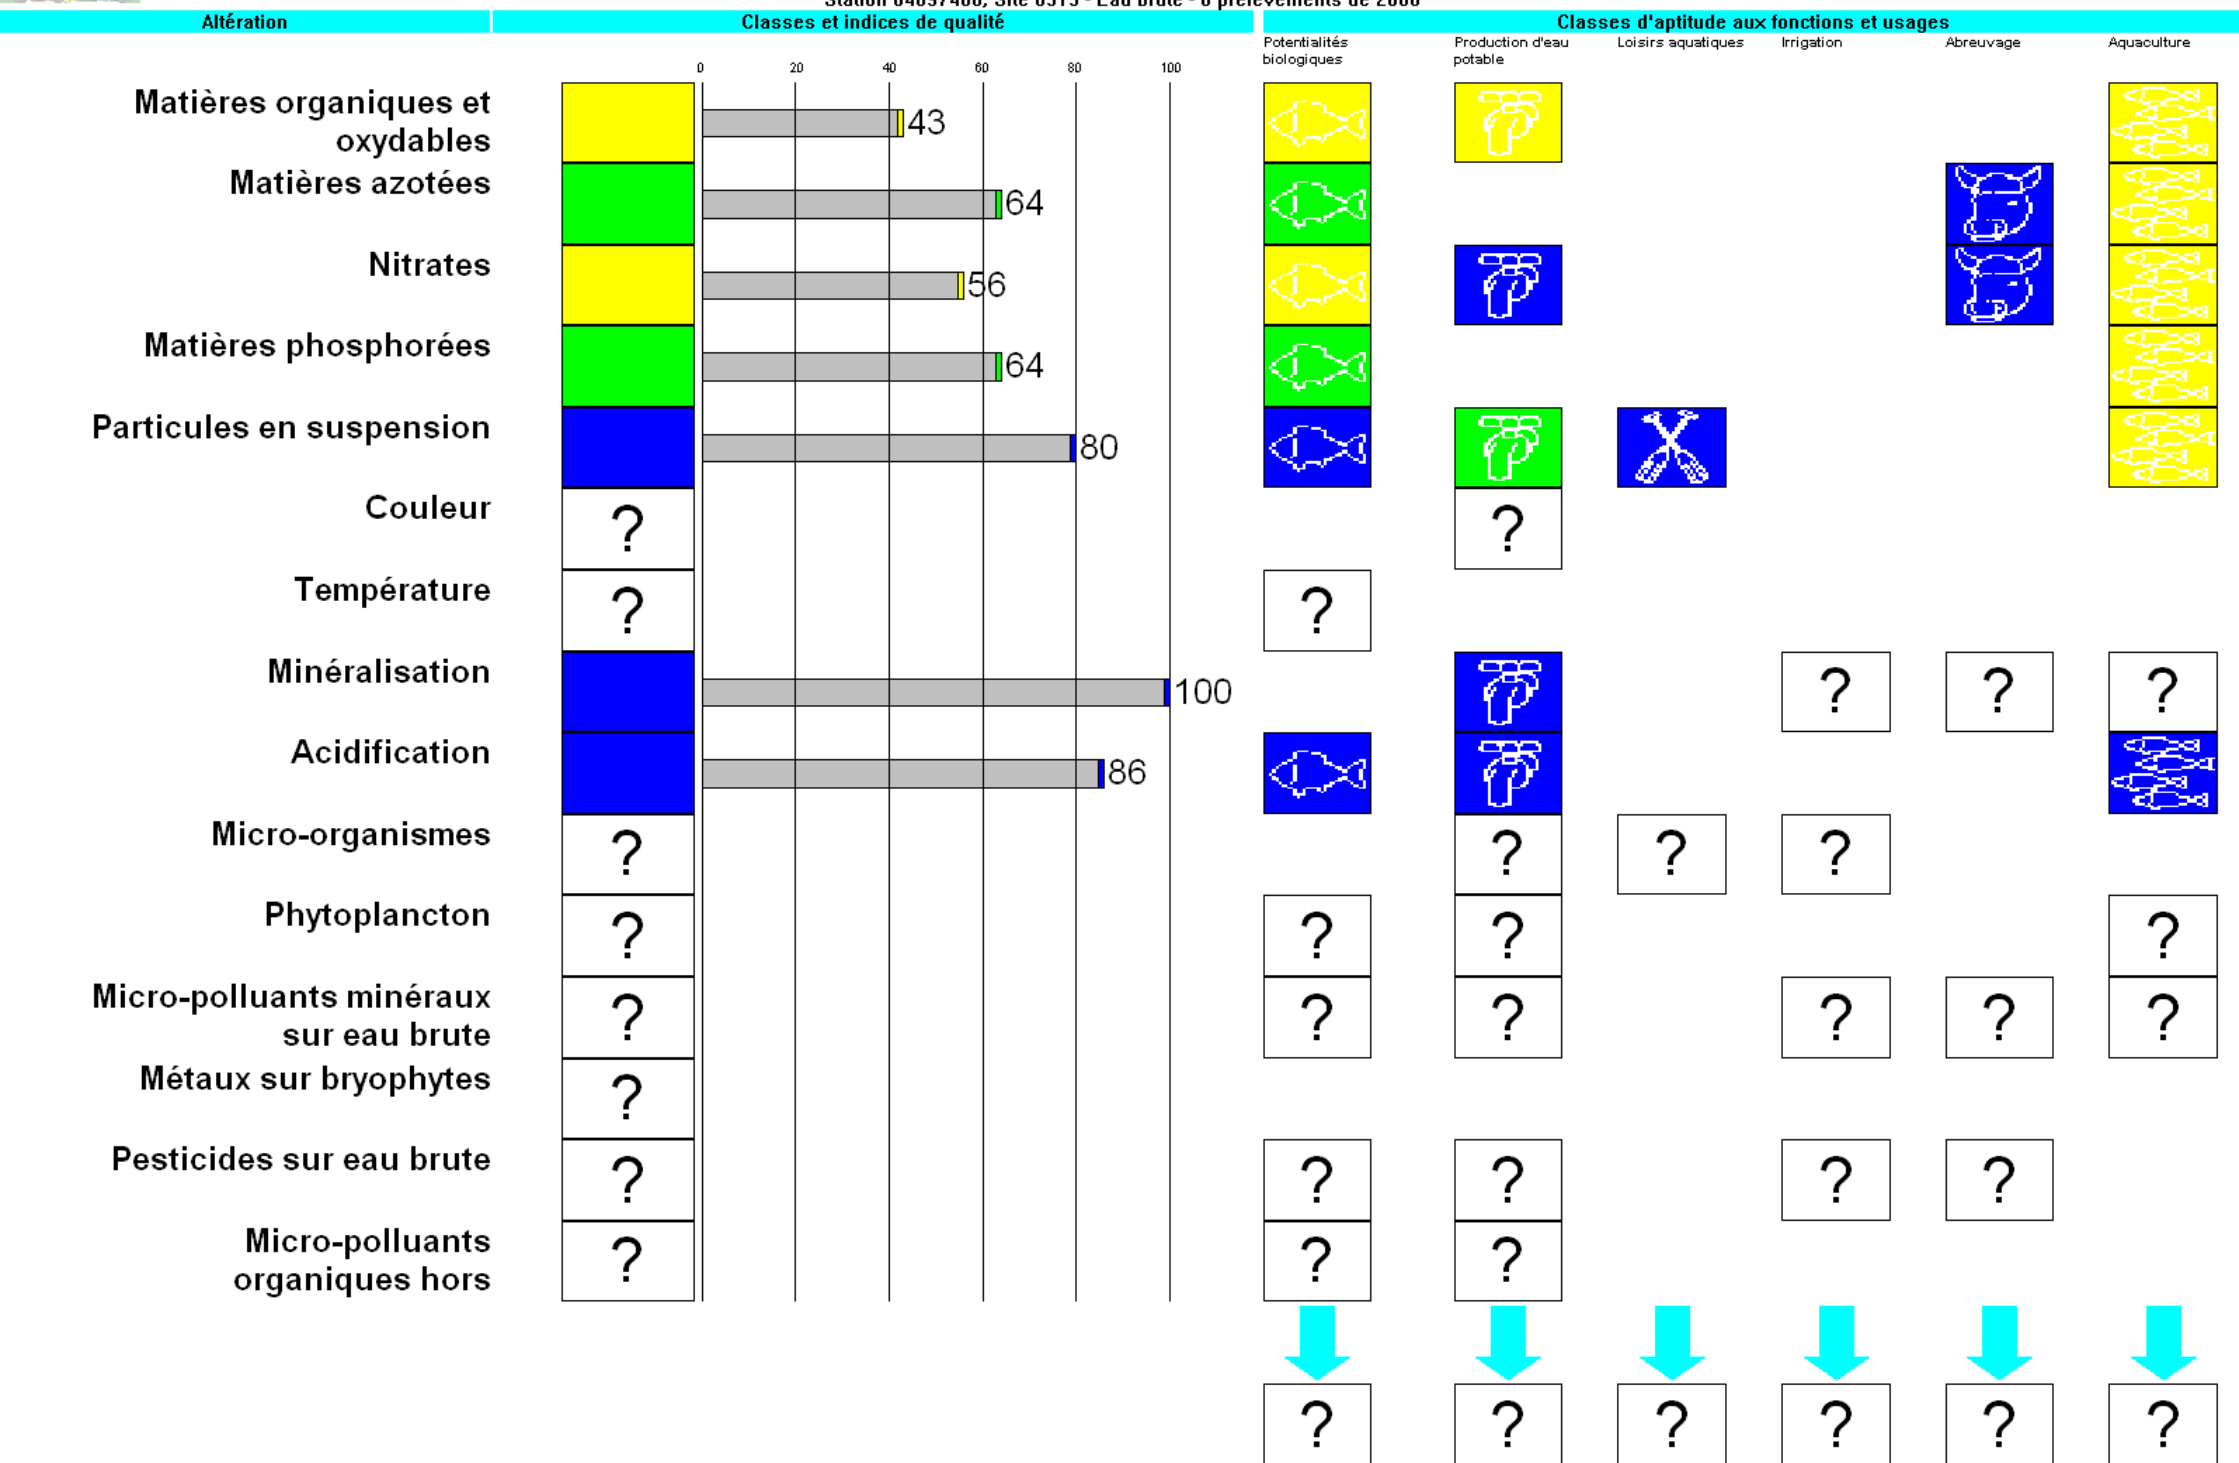

Altération, fonction ou usage non qualifié